

Volume – I

Tender Notification for

SUPPLY OF VARIOUS RATINGS OF OIL TYPE DISTRIBUTION TRANSFORMERS IN BRPL

CMC/BR/23-24/RB/PR/RJ/1149

Due Date for Submission of Bids: 11.08.2023

BSES RAJDHANI POWER LTD (BRPL)

BSES Bhawan, Nehru Place, New Delhi-110019 Corporate Identification Number: U74899DL2001PLC111527 Telephone Number: +91 11 3009 9999

> Fax Number: +91 11 2641 9833 Website: www.bsesdelhi.com



Section – I REQUEST FOR QUOTATION Tender Notification: CMC/BR/23-24/RB/PR/RJ/1149 **Supply Of Various Ratings of Oil Type Distribution Transformers In BRPL**



INDEX

		HVDEA	D 11
CECT	FION I	DEOLIECT FOR OLIOTATION	Page No.
	ΓΙΟΝ – Ι: ΓΙΟΝ – ΙΙ:		04 09
SEC	ΓΙΟΝ – III:	GENERAL CONDITIONS OF CONTRACT	17-25
1.0	GENERAL	INSTRUCTIONS	17
2.0		ON OF TERMS	18
3.0		T DOCUMENTS & PRIORITY	18
4.0		SUPPLY – GENERAL	19
5.0		ASSURANCE AND INSPECTION	19
6.0		PACKING LIST & MARKING	20
7.0	·	SIS FOR SUPPLY OF MATERIALS	20
8.0	VARIATIO	N IN TAXES, DUTIES & LEVIES	20
9.0		OUTIES ON RAW MATERIALS & BOUGHT OUT	
	COMPONE	ENTS	21
10.0	TERMS OF	PAYMENT AND BILLING	21
11.0	PRICE VA	LIDITY	20
12.0	PERFORM.	ANCE GUARANTEE	21
13.0	FORFEITU	RE	21
14.0	RELEASE		22
15.0	DEFECTS 1	LIABILITY PERIOD	22
16.0	RETURN, I	REPLACEMENT OR SUBSTITUTION	22
17.0	EFFECTIV	E DATE OF COMMENCEMENT OF CONTRACT	22
18.0	TIME – TH	E ESSENCE OF CONTRACT	22
19.0	THE LAWS	S AND JURISDICTION OF CONTRACT	22
20.0	EVENTS O	F DEFAULT	22
21.0	CONSEQU	ENCES OF DEFAULT	23
22.0	PENALTY	FOR DELAY	23
23.0	FORCE MA	AJEURE	23
24.0	TRANSFER	R AND SUB-LETTING	24
25.0	RECOVER	IES	25
26.0	WAIVER		25
27.0	INDEMNIF	TICATION	25
	ΓΙΟΝ – IV: ΓΙΟΝ – V:	QUANTITY AND DELIVERY REQUIREMENT TECHNICAL SPECIFICATION OF	26
SLC I	11014 4.	Oil Type DT	27



SECTION – I: REQUEST FOR QUOTATION

1.0 Event Information

NIT No.: CMC/BR/23-24/RB/PR/RJ/1149

1.01 BRPL invites sealed tenders for supply of various ratings of Package Substation from the manufacturers. The bidder must qualify the technical requirements as specified in clause 2.0 stated below. The sealed envelopes shall be duly super scribed as — "BID FOR SUPPLY OF VARIOUS RATINGS OF OIL TYPE DISTRIBUTION TRANSFORMERS FOR VARIOUS SITES OF BRPL ,TENDER NOTICE CMC/BR/23-24/RB/PR/RJ/1149 DUE FOR SUBMISSION ON DT. 11.08.2023".

Sl. No.	Item Description	Specification	Requirement Total Qty.	Estimated Cost		
	BRPL, DELHI					
1	Various Ratings of Oil Type DT for Various Sites in BRPL	SECTION V	105 Nos	1.50 Cr		

Note: Quantity may vary to any extent of +/- 30% of above mentioned total quantity.

1.02 The schedule of specifications with detail terms & conditions can be obtained from address given below against demand draft/Pay Order of Rs.1180/- with GST-, drawn in favour of BSES RAJDHANI POWER LTD, payable at New Delhi. The sale of tender documents will be issued from 21.07.2023 onwards on all working days upto 30.07.2023. The tender documents can also be downloaded from the website "www.bsesdelhi.com".

In case tender papers are downloaded from the above website, then the bidder has to enclose a demand draft covering the cost of bid documents as stated above in a separate envelope with suitable superscription —"Cost of Bid Documents: Tender Notice Ref: CMC/BR/23-24/RB/PR/RJ/1149". This envelope should accompany the Bid Documents.

1.03 Offers will be received upto 1545 Hrs. on dt. 11.08.2023 as indicated earlier and will be opened at the address given below dt. 11.08.2023 at 1555 Hrs. in the presence of authorized representatives of the bidders. The schedule of specifications with detail terms & conditions are enclosed. It is the sole responsibility of the bidder to ensure that the bid documents reach this office on or before the due date.

HEAD OF THE DEPARTMENT, 1st FLOOR, 'C' BLOCK, CONTRACTS & MATERIALS DEPARTMENT, BSES RAJDHANI POWER LTD, BSES BHAWAN, NEHRU PLACE, NEW DELHI-110019.

1.04 BRPL reserves the right to accept/ reject any or all Tenders without assigning any reason thereof and alter the quantity of materials mentioned in the Tender documents at the time of placing purchase orders. Tender will be summarily rejected if:



- i) Earnest Money Deposit (EMD) @ 2% (Two percent) of the Tender value i.e. **Rs. 3,00,000/-** is not deposited in shape of Bank Draft in favour of BSES RAJDHANI POWER LTD, payable at New Delhi or Bank Guarantee executed on favour of BSES RAJDHANI POWER LTD.
- ii) The offer does not contain "FOR, NEW DELHI price indicating break-up towards all taxes & duties".
- iii) Complete Technical details are not enclosed.
- iv) Tender is received after due time due to any reason.
- 1.05 BRPL reserves the right to reject any or all bids or cancel/ withdraw the invitation for bids without assigning any reason whatsoever and in such case no bidder/ intending bidder shall have any claim arising out of such action time of placing purchase orders.

2.0 Qualification Criteria:-

NIT No.: CMC/BR/23-24/RB/PR/RJ/1149

The prospective bidder must qualify all of the following requirements to be eligible to participate in the bidding. Bidders who meet following requirements will be considered as successful bidder and management has a right to disqualify those bidders who do not meet these requirements.

- 1) The bidder should have own manufacturing facility in India for Distribution transformer of similar rating or higher since last 3 years. Manufacturing and factory incorporation certificate/undertaking are submitted by bidder. The details of manufacturing units, locations and works from where supply against this tender shall be proposed to be furnished.
- 2) For 25 kVA,50 kVA & 63 kVA DT: The Bidder should have supplied at least 100 Nos of transformers of 25 kVA rating or higher ratings in last 5 years from the date of bid opening to any utilities/SEB's/PSU's/reputed company wherein the end user shall be Utility/SEB's/PSU's.
 - For 100 kVA DT: Bidders Quoting for 100 kVa shall furnish the supply details of 30 nos of 100 kVA rating or higher ratings in last 5 years from the date of bid opening to any utilities/SEB's/PSU's/reputed company wherein the end user shall be Utility/SEB's/PSU's..i. Summary list of executed Purchase orders ii. Purchase order copies iii. Material delivery clearance certificate copy or delivery completion certificates or invoice copies.
- 3) For 25 kVA,50 kVA & 63 kVA DT: Performance certificate for minimum 2 year satisfactory performance for 25 kVA or higher ratings supplied in last 7 years from the date of bid opening from at least two utilities/ SEB's/ PSU's/ reputed company wherein the end user shall be utilities/ SEB's/ PSU's.



For 100 kVA DT: Performance certificate for minimum 2 year satisfactory performance for 100 kVA or higher ratings supplied in last 7 years from the date of bid opening from at least two utilities/ SEB's/ PSU's/ reputed company wherein the end user shall be utilities/ SEB's/ PSU's.

In case of bidder has a previous association with BRPL/BYPL for similar product and service, the performance feedback for that bidder by BRPL/BYPL shall only be considered irrespective of performance certificate issued by any third organization. *Performance Certificate*

- 4) The bidder should have servicing, repairing, testing & refurbishment facility in INDIA with necessary spares and testing equipments for providing prompt after sales service for DT. Relevant Details/certificates/Undertaking. Details of the set-up available shall be brought out in the offer. The bidder shall submit undertaking along with the bid confirming the infrastructure details submitted.
- 5) The bidder should have plant installed capacity to supply of minimum 10 nos per month-Installed Capacity Certificate.
- 6) The Bidder must posses valid ISO 9001:2015 certification and BIS Licence. *Valid copy of Certification*
- 7) Bidder should have Average Annual Sales Turnover of Rs 10 Crores or more in last three (3) Financial Years Balance Sheet /CA Certificate to be submit
- 8) The Bidder shall submit an undertaking "No Litigation" is pending with the BRPL or its Group/Associates Companies as on date of bid opening.- *Undertaking*
- 9) An undertaking (self-certificate) that the bidder has not been blacklisted/debarred by any central/state government institution including electricity utilities as on date of bid opening.
 Undertaking
- 10) The bidder must have valid PAN No., GST Registration Number, in addition to other statutory compliances. The bidder must submit the copy of registrations and submit an undertaking that the bidder shall comply all the statuary compliances as per the laws/rules etc. before the start of the work- Relevant Statutory Documents Copy/Undertaking
- 11) In case of new bidders (not enlisted in BSES), Factory Inspection & evaluation shall be carried out to ascertain bidders manufacturing capabilities and quality procedures. BRPL reserves the right to assess the capabilities /installed capacity



3.0 Bidding and Award Process

NIT No.: CMC/BR/23-24/RB/PR/RJ/1149

Bidders are requested to submit their questions regarding the RFQ or the bidding process after review of this RFQ. BRPL response to the questions raised by various bidders will be distributed to all participating bidders through website.

a. Time schedule of the bidding process

The bidders on this RFQ package should complete the following within the dates specified as under:

S.No.	Steps	Activity description		
1	Technical Queries	All Queries related to RFQ	On or before 05.08.2023 1500 Hrs.	
2	Technical Offer	Documentary evidence in support of qualifying criteria. Technical Literature/ GTP/ Drawings/ Type test report, if any, etc., Testing facilities, any other relevant document, acceptance to commercial terms & conditions viz. delivery Schedule/ Period, Payment terms, PBG etc. Quality assurance plan, Deviation from the specification, list of plant & machinery and testing equipments Un priced items.	11.08.2023, 1545 Hrs	
3	Commercial Offer	Prices for Transformer and Break up regarding basic price and taxes. Delivery commitment	11.08.2023, 1545 Hrs	
4	Opening of technical bid	As per RFQ	11.08.2023, 1555 Hrs	

This is a two part bid process. Bidders are to submit the bids (a) Technical Bid (b) Price Bid. Both these parts should be furnished in separate sealed covers super scribing with specification no., validity etc, with particulars as **Part-I** "**Technical Particulars & Commercial Terms & Conditions**" and **Part-II** "**Financial bid**" and these sealed envelopes should again be placed in another sealed cover which shall be submitted before the due date & time specified.

Bidders are requested to submit the bid in one original plus one copy in duplicate.

• <u>The Part-I (Technical Bid)</u> - Technical Bid should not contain any cost information whatsoever. In case of Bids where the qualification requirements, technical suitability and other requirements are found to be inadequate, Part-II "Financial Bid" will be returned unopened.



• The Part-II (Financial Bid) - Qualified bidders will be intimated after technical evaluation of all the bids is completed. The date and time of same shall be intimated in due course to the qualified bidders. Notwithstanding anything stated above, the Purchaser reserves the right to assess bidder's capability to perform the contract, should the circumstances warrant such assessment in the overall interest of the purchaser. In this regard the decision of the purchaser is final.

4.0 Award Decision

Purchaser intends to award the business on a lowest bid basis, so suppliers are encouraged to bid competitively. The decision to place purchase order / letter of acceptance solely depends on purchaser on the cost competitiveness across multiple lots, quality, delivery and bidder's capacity, in addition to other factors that Purchaser may deem relevant.

The purchaser reserves all the rights to award the contract to one or more bidders so as to meet the delivery requirement or nullify the award decision without any reason.

BSES reserves the right to split the tender quantity amongst techno commercially qualified bidders on account of delivery requirement in tender, quantity under procurement etc.

Splitting of tender quantity amongst more than one bidder shall be governed by below mentioned guidelines:

- If the quantity is to be split among 2 bidders, it will be done in the ratio of 70:30 on L1 price.
- If the quantity is to be split among 3 bidders, it will be done in the ratio of 60:25:15 on L1 price.
- In case quantity needs to be distributed and order splitting is required, distribution of quantity shall be maximum among three (3) bidders.

In the event of your bid being selected by purchaser (and / or its affiliates) and your subsequent DEFAULT on your bid; you will be required to pay purchaser (and / or its affiliates) an amount equal to the difference in your bid and the next lowest bid on the quantity declared in RFQ.

In case any supplier is found unsatisfactory during the delivery process, the award will be cancelled and BRPL reserves the right to award other suppliers who are found fit.

Quantity Variation: The purchaser reserves the rights to vary the quantity by +/- 30% of the tender quantity.

Repeat Order: BRPL reserves the right to place repeat order at the same rates & terms and conditions as per this tender against additional requirement subject to mutual agreement between BRPL & supplier.

5.0 Market Integrity:

NIT No.: CMC/BR/23-24/RB/PR/RJ/1149

We have a fair and competitive marketplace. The rules for bidders are outlined in the Terms & Conditions. Bidders must agree to these rules prior to participating. In addition to other



remedies available, we reserves the right to exclude a bidder from participating in future markets due to the bidder's violation of any of the rules or obligations contained in the Terms & Condition. Bidders who violate the marketplace rules or engage in behavior that disrupts the fair execution of the marketplace restricts a bidder to length of time, depending upon the seriousness of the violation. Examples of violations include, but are not limited to:

- Failure to honor prices submitted to the marketplace.
- Breach of the terms of the published in Request For Quotation.

6.0 Supplier Confidentiality

All information contained in this RFQ is confidential and may not be disclosed, published or advertised in any manner without written authorization from BRPL. This includes all bidding information submitted.

All RFQ documents remain the property of BRPL and all suppliers are required to return these documents to BRPL upon request.


Suppliers who do not honor these confidentiality provisions will be excluded from participating in future bidding events.

7.0 Contact Information

NIT No.: CMC/BR/23-24/RB/PR/RJ/1149

All communication as regards this RFQ shall be made (i) in English, (ii) in writing and (iii) sent by mail, facsimile to:

	Technical	Commercial
Contact Name	Mr. Amit Tomar	Ms Rachna Jain
	Copy to Mr. Gopal Nariya	Copy to Mr. Pankaj Goyal
Address	BSES RAJDHANI POWER LTD,	C&M Deptt. 1st floor, D- Block,
	2nd Floor, B Block, Nehru Place, New	BSES Rajhdhani Power Limited,
	Delhi – 110019	BSES Bhawan, Nehru Place,
		New Delhi -110019
Email-ID	amit.as.tomar@relianceada.com	rachna.jain@relianceada.com
	gopal.nariya@relianceada.com	pankaj.goyal@relianceada.com

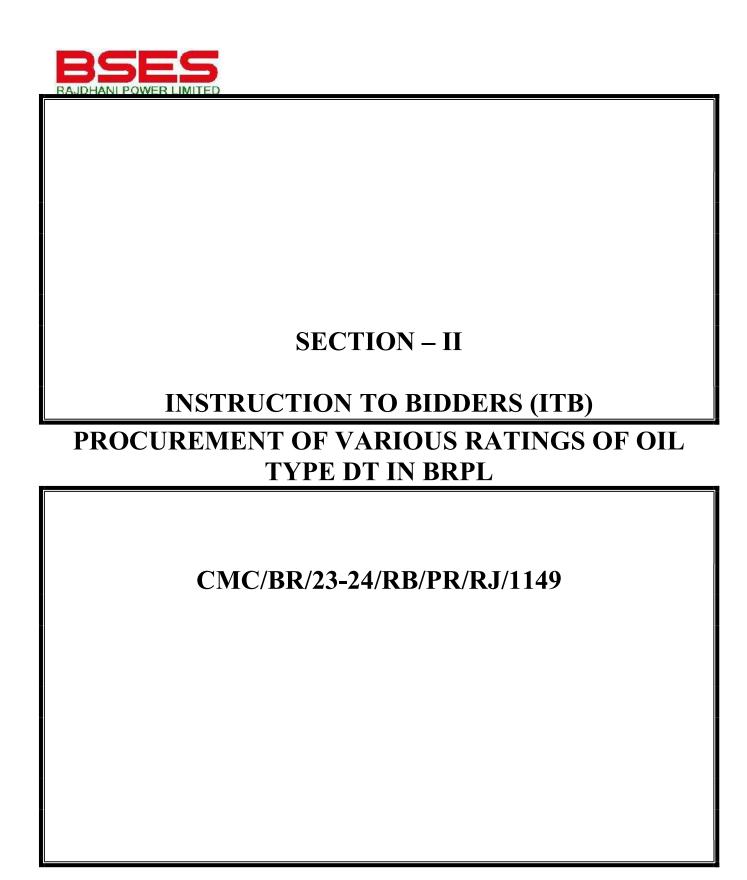



1.00 BSES Rajdhani power Ltd, hereinafter referred to as the Purchaser are desirous of implementing the various Systems Improvement/Repair & Maintenance works at their respective licensed area in Delhi. The Purchaser has now floated this tender for procurement of Oil type Distribution Transformers as notified earlier in this bid document.

2.00 SCOPE OF WORK

The scope shall include Design, Manufacture, Testing at works conforming to the Technical Specifications enclosed along with Packing, Forwarding, Freight and Unloading and proper stacking at Purchaser's stores.

3.00 DISCLAIMER

- 3.01 This Document includes statements, which reflect various assumptions, which may or may not be correct. Each Bidder/ Bidding Consortium should conduct its own estimation and analysis and should check the accuracy, reliability and completeness of the information in this Document and obtain independent advice from appropriate sources in their own interest.
- 3.02 Neither Purchaser nor its employees will have any liability whatsoever to any Bidder or any other person under the law or contract, the principles of restitution or unjust enrichment or otherwise for any loss, expense or damage whatsoever which may arise from or be incurred or suffered in connection with anything contained in this Document, any matter deemed to form part of this Document, provision of Services and any other information supplied by or on behalf of Purchaser or its employees, or otherwise a rising in any way from the selection process for the Supply.
- 3.03 Though adequate care has been taken while issuing the Bid document, the Bidder should satisfy itself that Documents are complete in all respects. Intimation of any discrepancy shall be given to this office immediately.
- 3.04 This Document and the information contained herein are Strictly Confidential and are for the use of only the person(s) to whom it is issued. It may not be copied or distributed by the recipient to third parties (other than in confidence to the recipient's professional advisors).

4.00 COST OF BIDDING

The Bidder shall bear all cost associated with the preparation and submission of its Bid and Purchaser will in no case be responsible or liable for those costs.

B BIDDING DOCUMENT

5.00 BIDDING DOCUMENTS

NIT No.: CMC/BR/23-24/RB/PR/RJ/1149

5.01 The Scope of Work, Bidding Procedures and Contract Terms are described in the Bidding Documents. In addition to the covering letter accompanying Bidding Documents, the Bidding Documents include:



Volume –I

a)	Request for Quotation (RFQ)	- Section – I
b)	Instructions to Bidders (ITB)	- Section – II
c)	General Conditions of Contract	- Section - III
d)	Quantity and delivery requirement	- Section –IV
e)	Technical Specifications (TS)	- Section –V

Volume – II

a)	Bid Form	- Annexure – I
b)	Bid Format	- Annexure – II
c)	Price Schedule	- Annexure – III
d)	Commercial Terms & Conditions	- Annexure - IV
e)	No Deviation Sheet	- Annexure - V
f)	Qualification Criterion	- Annexure - VI

5.02 The Bidder is expected to examine the Bidding Documents, including all Instructions, Forms, Terms and specifications. Failure to furnish all information required by the Bidding documents or submission of a Bid not substantially responsive to the Bidding Documents in every respect will may result in the rejection of the Bid.

6.00 AMENDMENT OF BIDDING DOCUMENTS

- 6.01 At any time prior to the deadline for submission of Bids, the Purchaser may for any reasons, whether at its own initiative or in response to a clarification requested by a prospective Bidder, modify the Bidding Documents by Amendment.
- 6.02 The Amendment shall be part of the Bidding Documents, pursuant to Clause 5.01, and it will be notified in writing by Fax/e-mail to all the Bidders who have received the Bidding Documents and confirmed their participation to Bid, and will be binding on them.
- 6.03 In order to afford prospective Bidders reasonable time in which to take the Amendment into account in preparing their Bids, the Purchaser may, at its discretion, extend the deadline for the submission of Bids.

C PREPARATION OF BIDS

7.00 LANGUAGE OF BID

The Bid prepared by the Bidder, and all correspondence and documents relating to the Bid exchanged by the Bidder and the Purchaser, shall be written in the English Language. Any printed literature furnished by the Bidder may be written in another Language, provided that this literature is accompanied by an English translation, in which case, for purposes of interpretation of the Bid, the English translation shall govern.

8.00 DOCUMENTS COMPRISING THE BID

The Bid prepared and submitted by the Bidder shall comprise the following components:



- a) Bid Form ,Price & other Schedules (STRICTLY AS PER FORMAT)and Technical Data Sheets completed in accordance with Clause 9.0, 10.0, 11.0 and Technical Specification;
- b) All the Bids must be accompanied with the required EMD as mentioned in the Section-I against each tender.
- c) Power of Attorney or Authorization letter indicating that the person(s) signing the Bid have the authority to sign the Bid and thus that the Bid is binding upon the Bidder during the full period of its validity, in accordance with clause 12.0.

9.00 BID FORM

9.01 The Bidder shall complete an "Original" and another one "Copy" of the Bid Form and the appropriate Price & Other Schedules and Technical Data Sheets.

9.02 **EMD**

Pursuant to Clause 8.0(b) above, the bidder shall furnish, as part of its bid, a EMD amounting to 2% of the total bid value (FOR Destination) i.e. Rs. **3,00,000**/-. The EMD is required to protect the Purchaser against the risk of Bidder's conduct which would warrant the security's forfeiture.

The EMD shall be denominated in the currency of the bid, and shall be in the following form:

- a) A bank guarantee issued by any scheduled bank strictly as per the form at enclosed and shall be valid for a period of thirty (30) days beyond the validity of the bid.
- b) Bank Draft in favour of BSES RAJDHANI POWER LTD, payable at New Delhi.

Unsuccessful bidders' EMD will be discharged or returned as promptly as possible as but not later than thirty (30) days after the expiration of the period of bid validity.

The successful bidder's EMD will be discharged upon furnishing the performance security. The EMD may be forfeited:

- a) If the Bidder:
 - i) Withdraws its bid during the period of bid validity specified by the Bidder in the Bid Form; or
- b) in the case of a successful Bidder, if the Bidder fails:
 - i) to sign the Contract, or

NIT No.: CMC/BR/23-24/RB/PR/RJ/1149

ii) to furnish the required performance security.

10.00 BID PRICES

10.01 Bidders shall quote for the entire Scope of Supply with a break-up of prices for individual items. The total Bid Price shall also cover all the Supplier's obligations mentioned in or



reasonably to be inferred from the Bidding Documents in respect of Design, Supply, Transportation to site, all in accordance with the requirement of Bidding Documents The Bidder shall complete the appropriate Price Schedules included herein, stating the Unit Price for each item & total Price.

10.02 The prices offered shall be inclusive of all costs as well as Duties, Taxes and Levies paid or payable during execution of the supply work, breakup of price constituents, should be there. Prices quoted by the Bidder shall be—Firm "and not subject to any price adjustment during the performance of the Contract. A Bid submitted with an adjustable price quotation will be treated as non -responsive and rejected.

11.00 BID CURRENCIES

Prices shall be quoted in **Indian Rupees (INR) only**.

12.00 PERIOD OF VALIDITY OF BIDS

- 12.01 Bids shall remain valid for **120 days** post bid date.
- 12.02 Notwithstanding Clause 12.01 above, the Purchaser may solicit the Bidder's consent to an extension of the Period of Bid Validity. The request and the responses thereto shall be made in writing by Fax/e-mail.

13.00 ALTERNATIVE BIDS

Bidders shall submit Bids, which comply with the Bidding Documents. Alternative Bids will not be considered. The attention of Bidders is drawn to the provisions of Clause 22.03 & 22.04 regarding the rejection of Bids, which are not substantially responsive to the requirements of the Bidding Documents.

14.00 FORMAT AND SIGNING OF BID

- 14.01 The original Bid Form and accompanying documents (as specified in Clause9.0), clearly marked "Original Bid", plus one copy must be received by the Purchaser at the date, time and place specified pursuant to Clauses15.0 and16.0. In the event of any discrepancy between the original and the copies, the original shall govern.
- 14.02 The original and copy of the Bid shall be typed or written in indelible ink and shall be signed by the Bidder or a person or persons duly authorized to sign on behalf of the Bidder. Such authorization shall be indicated by written Power-of-Attorney accompanying the Bid.
- 14.03 The Bid shall contain no interlineations, erasures or overwriting except as necessary to correct errors made by the Bidder, in which case such corrections shall be initialed by the person or persons signing the Bid.

D SUBMISSION OF BIDS



15.0 SEALING AND MARKING OF BIDS

- 15.01 Bid submission: One original & one Copy (hard copies) of all the Bid Documents shall be sealed and submitted to the Purchaser before the closing time for submission of the bid.
- 15.02 The Technical Documents and the EMD shall be enclosed in a sealed envelope and the said envelope shall be superscribed with —**Technical & EMD**. The Financial bid shall be inside another sealed envelope with superscription **Financial Bid**. Both these envelopes shall be sealed inside another big envelope. All the envelopes should bear the Name and Address of the Bidder and marking for the Original and Copy. The envelopes should be superscribed with —"**Tender Notice No, Due date of submission, Tender opening date**".
- 15.03 The Bidder has the option of sending the Bids in person. Bids submitted by Telex/ Telegram/ Fax will not be accepted. No request from any Bidder to the Purchaser to collect the proposals from Airlines/Cargo Agents etc shall be entertained by the Purchaser.

16.0 DEADLINE FOR SUBMISSION OF BIDS

- 16.01 The original Bid, together with the required copies, must be received by the Purchaser at the address specified not later than **1545 HRS on 11.08.2023**.
- 16.02 The Purchaser may, at its discretion, extend the deadline for the submission of Bids by amending the Bidding Documents in accordance with Clause 9.0, in which case all rights and obligations of the Purchaser and Bidders previously subject to the deadline will thereafter be subject to the deadline as extended.

17.0 ONE BID PER BIDDER

Each Bidder shall submit only one Bid. A Bidder who submits or participates in more than one Bid will cause all those Bids to be rejected.

18.00 LATE BIDS

Any Bid received by the Purchaser after the deadline for submission of Bids prescribed by the Purchaser, pursuant to Clause 16.0, will be declared "Late" and rejected and returned unopened to the Bidder.

19.00 MODIFICATIONS AND WITHDRAWAL OF BIDS

19.01 The Bidder is not allowed to modify or withdraw its Bid after the Bid's submission.

E. EVALUATION OF BID

20.00 PROCESS TO BE CONFIDENTIAL

NIT No.: CMC/BR/23-24/RB/PR/RJ/1149

Information relating to the examination, clarification, evaluation and comparison of Bids and recommendations for the award of a contract shall not be disclosed to Bidders or any other



persons not officially concerned with such process. Any effort by a Bidder to influence the Purchaser's processing of Bids or award decisions may result in the rejection of the Bidder's Bid.

21.00 CLARIFICATION OF BIDS

To assist in the examination, evaluation and comparison of Bids, the Purchaser may, at its discretion, ask the bidder for a clarification of its Bid. All responses to requests for clarification shall be in writing and no change in the price or substance of the Bid shall be sought, offered or permitted.

22.00 PRELIMINARY EXAMINATION OF BIDS / RESPONSIVENESS

- 22.01 Purchaser will examine the Bids to determine whether they are complete, whether any computational errors have been made, whether required sureties have been furnished, whether the documents have been properly signed, and whether the Bids are generally in order.
- 22.02 Arithmetical errors will be rectified on the following basis. If there is a discrepancy between the unit price and the total price per item that is obtained by multiplying the unit price and quantity, the unit price shall prevail and the total price per item will be corrected. If there is a discrepancy between the Total Amount and the sum of the total price per item, the sum of the total price per item shall prevail and the Total Amount will be corrected.
- 22.03 Prior to the detailed evaluation, Purchaser will determine the substantial responsiveness of each Bid to the Bidding Documents including production capability and acceptable quality of the Goods offered. A substantially responsive Bid is one, which conforms to all the terms and conditions of the Bidding Documents without material deviation.
- 22.04 Bid determined as not substantially responsive will be rejected by the Purchaser and/or the Purchaser and may not subsequently be made responsive by the Bidder by correction of the non-conformity.

23.0 EVALUATION AND COMPARISON OF BIDS

- 23.01 The evaluation of Bids shall be done based on the delivered cost competitiveness basis.
- 23.02 The evaluation of the Bids shall be a stage-wise procedure. The following stages are identified for evaluation purposes: In the first stage, the Bids would be subjected to a responsiveness check. The Technical Proposals and the Conditional ties of the Bidders would be evaluated. Subsequently, the Financial Proposals along with supplementary Financial Proposals, if any, of Bidders with Techno-commercially Acceptable Bids shall be considered for final evaluation.
- 23.03 The Purchaser's evaluation of a Bid will take into account, in addition to the Bid price, the following factors, in the manner and to the extent indicated in this Clause:
- (a) Supply Schedule
- (b) Deviations from Bidding Documents



Bidders shall base their Bid price on the terms and conditions specified in the Bidding Documents. The cost of all quantifiable deviations and omissions from the specification, terms and conditions specified in Bidding Documents shall be evaluated. The Purchaser will make its own assessment of the cost of any deviation for the purpose of ensuring fair comparison of Bids.

23.04 Any adjustment in price, which results from the above procedure, shall be added for the purposes of comparative evaluation only to arrive at an "Evaluated Bid Price". Bid Prices quoted by Bidders shall remain unaltered.

F. AWARD OF CONTRACT

24.0 CONTACTING THE PURCHASER

- 24.01 From the time of Bid submission to the time of contract award, if any Bidder wishes to contact the Purchaser on any matter related to the Bid, it should do so in writing.
- 24.02 Any effort by a Bidder to influence the Purchaser and/or in the Purchaser's decisions in respect of Bid evaluation, Bid comparison or Contract Award, will result in the rejection of the Bidder's Bid.

25.0 THE PURCHASER 'S RIGHT TO ACCEPT ANY BID AND TO REJECT ANY OR ALL BIDS

The Purchaser reserves the right to accept or reject any Bid and to annul the Bidding process and reject all Bids at anytime prior toward of Contract, without thereby incurring any liability to the affected Bidder or Bidders or any obligation to inform the affected Bidder or Bidders of the grounds for the Purchaser's action.

26.0 AWARD OF CONTRACT

NIT No.: CMC/BR/23-24/RB/PR/RJ/1149

The Purchaser will award the Contract to the successful Bidder whose Bid has been Determined to be the lowest-evaluated responsive Bid, provided further that the Bidder has been determined to be qualified to satisfactorily perform the Contract. Purchaser reserves the right to award order other bidders in the tender, provided it is required for progress of project & provided he agrees to come to the lowest rate.

27.0 THE PURCHASER'S RIGHT TO VARY QUANTITIES

The Purchaser reserves the right to vary the quantity i.e. increase or decrease the numbers/quantities without any change in terms and conditions during the execution of the Order.

28.0 LETTER OF INTENT/ NOTIFICATION OF AWARD

The letter of intent/ Notification of Award shall be issued to the successful Bidder whose bids have been considered responsive, techno-commercially acceptable and evaluated to be the



lowest (L1). The successful Bidder shall be required to furnish a letter of acceptance within 7 days of issue of the letter of intent /Notification of Award by Purchaser.

29.0 PERFORMANCE BANK GUARANTEE

The successful Bidder shall furnish the Performance Bank Guarantee for an amount of 10% (Ten percent) of the Contract Price in accordance with the format provided. The Performance Bond shall be valid for a period of twenty four months (24) from the date of the commissioning or thirty months (30) from the date of receipt of material (last consignment) at site/stores whichever is earlier plus 3 months towards claim period. Upon submission of the performance security, the EMD shall be released.

30.00 CORRUPT OR FRADULENT PRACTICES

- 30.01 The Purchaser requires that the Bidders observe the highest standard of ethics during the procurement and execution of the Project. In pursuance of this policy, the Purchaser:
- (a) Defines, for the purposes of this provision, the terms set forth below as follows:
 - i) "Corrupt practice" means behavior on the part of officials in the public or private sectors by which they improperly and unlawfully enrich themselves and/or those close to them ,or induce others to do so, by misusing the position in which they are placed, and it includes the offering, giving, receiving, or soliciting of anything of value to influence the action of any such official in the procurement process or in contract execution; and
 - ii) "Fraudulent practice" means a misrepresentation of facts in order to influence a procurement process or the execution of a contract to the detriment of the Purchaser, and includes collusive practice among Bidders (prior to or after Bid submission) designed to establish Bid prices at artificial non-competitive levels and to deprive the Purchaser of the benefits of free and open competition.
- (b) Will reject a proposal forward if it determines that the Bidder recommended for award has engaged in corrupt or fraudulent practices in competing for the contract in question;
- (c) Will declare a firm ineligible, either indefinitely or for a stated period of time, to be awarded a contract if it at any time determines that the firm has engaged in corrupt or fraudulent practices in competing for, or in executing, a contract.
- 30.02 Furthermore, Bidders shall be aware of the provision stated in the General Conditions of Contract.



SECTION – III GENERAL CONDITIONS OF CONTRACT (GCC)

PROCUREMENT OF VARIOUS RATINGS OF OIL TYPE DISTRIBUTION TRANSFORMERS IN BRPL

CMC/BR/23-24/RB/PR/RJ/1149



GENERAL TERMS AND CONDITIONS

1.0 General Instructions

- 1.01 All the Bids shall be prepared and submitted in accordance with these instructions.
- 1.02 Bidder shall bear all costs associated with the preparation and delivery of its Bid, and the Purchaser will in no case shall be responsible or liable for these costs.
- 1.03 The Bid should be submitted by the Bidder in whose name the bid document has been issued and under no circumstances it shall be transferred/ sold to the other party.
- 1.04 The Purchaser reserves the right to request for any additional information and also reserves the right to reject the proposal of any Bidder, if in the opinion of the Purchaser, the data in support of RFQ requirement is incomplete.
- 1.05 The Bidder is expected to examine all instructions, forms, terms & conditions and specifications in the Bid Documents. Failure to furnish all information required in the Bid Documents or submission of a Bid not substantially responsive to the Bid Documents in every respect may result in rejection of the Bid. However, the Purchaser's decision in regard to the responsiveness and rejection of bids shall be final and binding without any obligation, financial or otherwise, on the Purchaser.

2.0 Definition of Terms

- 2.01 "Purchaser" shall mean BRPL Limited, on whose behalf this bid enquiry is issued by its authorized representative / officers.
- 2.02 "Bidder" shall mean the firm who quotes against this bid enquiry issued by the Purchaser. "Supplier" or "Supplier" shall mean the successful Bidder and/or Bidders whose bid has been accepted by the Purchaser and on whom the "Letter of Acceptance" is placed by the Purchaser and shall include his heirs, legal representatives, successors and permitted assigns wherever the context so admits.
- 2.03 "Supply" shall mean the Scope of Contract as described.
- 2.04 "Specification" shall mean collectively all the terms and stipulations contained in those portions of this bid document known as RFQ, Commercial Terms & Condition, Instructions to Bidders, Technical Specifications and the Amendments, Revisions, Deletions or Additions, as may be made by the Purchaser from time to time.
- 2.05 "Letter of Acceptance" shall mean the official notice issued by the Purchaser notifying the Supplier that his proposal has been accepted and it shall include amendments thereto, if any, issued by the Purchaser. The "Letter of Acceptance" issued by the Purchaser shall be binding on the "Supplier" The date of Letter of Acceptance shall be taken as the effective date of the commencement of contract.



- 2.06 "Month" shall mean the calendar month and "Day" shall mean the calendar day.
- 2.07 "Codes and Standards" shall mean all the applicable codes and standards as indicated in the Specification.
- 2.08 "Offer Sheet" shall mean Bidder's firm offer submitted to BRPL in accordance with the specification.
- 2.09 "Contract" shall mean the "Letter of Acceptance" issued by the Purchaser.
- 2.10 "Contract Price" shall mean the price referred to in the "Letter of Acceptance".
- 2.11 "Contract Period" shall mean the period during which the "Contract" shall be executed as agreed between the Supplier and the Purchaser in the Contract inclusive of extended contract period for reason beyond the control of the Supplier and/or Purchaser due to force majeure.
- 2.12 "Acceptance" shall mean and deemed to include one or more of the following as will be stipulated in the specification:
- a) The written acceptance of material by the inspector at suppliers works to ship the materials.
- b) Acceptance of material at Purchaser site stores after its receipt and due inspection/ testing and release of material acceptance voucher.
- c) Where the scope of the contract includes supply, acceptance shall mean issue of necessary equipment / material takeover receipt after installation & commissioning and final acceptance.

3.0 Contract Documents & Priority

- 3.01 Contract Documents: The terms and conditions of the contract shall consist solely of these RFQ conditions and the offer sheet.
- 3.02 Priority: Should there be any discrepancy between any term hereof and any term of the Offer Sheet, the terms of these RFQ shall prevail.

4.0 Scope of Supply - General

- 4.01 The "Scope of Supply" shall be on the basis of Bidder's responsibility, completely covering the obligations, responsibility and supplies provided in this Bid enquiry whether implicit or explicit.
- 4.02 Bidder shall have to quote for the Bill of quantities as listed in Section IV of this RFQ.
- 4.03 Quantity variation and additional requirement if any shall be communicated to successful bidder during project execution.
- 4.04 All relevant drawings, data and instruction manuals.



5.0 Quality Assurance and Inspection

- 5.01 Immediately on award of contract, the bidder shall prepare detailed quality assurance plan / test procedure identifying the various stages of manufacture, quality checks performed at each stage, raw material inspection and the Customer hold points. The document shall also furnish details of method of checking, inspection and acceptance standards / values and get the approval of Purchaser before proceeding with manufacturing. However, Purchaser shall have right to review the inspection reports, quality checks and results of suppliers in house inspection department which are not Customer hold points and the supplier shall comply with the remarks made by purchaser or his representative on such reviews with regards to further testing, rectification or rejection, etc.
- 5.02 Witness and Hold points are critical steps in manufacturing, inspection and testing where the supplier is obliged to notify the Purchaser in advance so that it may be witnessed by the Purchaser. Final inspection is a mandatory hold point. The supplier needs to proceed with the work past a hold point only after clearance by purchaser or a witness waiver letter from BRPL.
- 5.03 The performance of waiver of QA activity by Purchaser at any stage of manufacturing does not relieve the supplier of any obligation to perform in accordance with and meet all the requirements of the procurement documents and also all the codes & reference documents mentioned in the procurement document nor shall it preclude subsequent rejection by the purchaser.
- 5.04 On completion of manufacturing the items can be dispatched only after issue of shipping release by the Purchaser.
- 5.05 All testing and inspection shall be done without any extra cost.
- 5.06 Purchaser reserve the right to send any material out of the supply to any recognized laboratory for testing and the cost of testing shall be borne by the Purchaser. In case the material is found not in order with the technical requirement / specification, the charges along with any other penalty which may be levied is to be borne by the bidder. To avoid any complaint the supplier is advised to send his representative to the stores to see that the material sent for testing is being sealed in the presence of bidders representative.
- 5.07 Bidder has to sign quality agreement before supply of the material.

6.0 Packing, Packing List & Marking

- 6.01 Packing: Supplier shall pack or shall cause to be packed all Commodities in boxes and containers and otherwise in such a manner as shall be reasonably suitable for shipment by road or rail to BRPL without undue risk of damage in transit.
- 6.02 Packing List: The contents of each package shall be itemized on a detailed list showing the exact weight and the extreme outside dimensions (length, width and eight) of each container or box. One copy of the packing list shall be enclosed in each package delivered. There shall



also be enclosed in one package a master packing list identifying each individual package, which is part of the shipment. On any packaging where it is not feasible to place the packing list inside the container, all pertinent information shall be stenciled on the outside and will thus constitute a packing list.

7.01 Prices basis for supply of materials

Bidders require quoting their prices on Landed Cost Basis and separate price for each item. For Supply to BRPL Delhi the price shall be inclusive of packing, forwarding, GST and freights. The above supply prices shall also include unloading at site stores. Transit and storage insurance will be arranged by BRPL; however bidder to furnish required details in advance for arranging the same by BRPL.

8.0 Variation in taxes, duties & levies:

- 8.01 The total order value shall be adjusted on account of any variations in Statutory Levies imposed by Competent Authorities by way of fresh notification(s) within the stipulated delivery period only. However, in case of reduction in taxes, duties and levies, the benefits of the same shall be passed on to BUYER.
- 8.02 No other Taxes, Duties & Levies other than those specified above will be payable by BUYER except in case of new Levies, Taxes & Duties imposed by the Competent Authorities by way of fresh notification(s) subsequent to the issue of PURCHASE ORDER but within the stipulated delivery period.
- 8.03 Notwithstanding what is stated above, changes in Taxes, Duties & Levies shall apply only to that portion of PURCHASE ORDER not executed on the date of notification by Competent Authority. Further, changes in Taxes, Duties & Levies after due date of Delivery shall not affect PURCHASE ORDER Terms and Value.
- 8.04 PURCHASE ORDER value shall not be subject to any variation on account of variation in Exchange rate(s).

9.0 Taxes & Duties on raw materials & bought out components:

- 9.01 Taxes & Duties on raw materials & bought out components are included in Order Value and are not subject to any escalation or variation for any reason whatsoever.
- 9.02 Taxes & Duties on raw materials & bought out components procured indigenously are included in Order Value and are not subject to any escalation or variation for any reason whatsoever.

10.0 Terms of payment and billing

- 10.01 For Supply of Equipments:
- 100% payment shall be made within 45 days from the date of receipt of material at store/ site against submission of 10 % performance bank guarantee. (Refer 10.01)



- 10.02 Bidder to submit the following documents against dispatch of each consignment:
- i) Consignee copy of LR
- ii) Supplier detailed invoice showing commodity description, quantity, unit price, total price and basis of delivery.
- iii) Original certificate issued by BRPL confirming receipt of material at site and acceptance of the same.
- iv) Dispatch clearance / inspection report in original issued by the inspection authority
- v) Packing List.
- vi) Test Reports
- vii) Guarantee Certificate.
- viii) Insurance policy to be obtained by supplier

11.0 Price Validity

11.01 All bids submitted shall remain valid, firm and subject to unconditional acceptance by BRPL Delhi for 120 days post bid-date. For awarded suppliers, the prices shall remain valid and firm till contract completion.

12.0 Performance Guarantee

- 12.01 The successful Bidder shall furnish the Performance Bank Guarantee for an amount of 10% (Ten percent) of the Contract Price in accordance with the format provided. The Performance Bond shall be valid for a period of twenty four months (24) from the date of the commissioning or thirty months (30) from the date of receipt of material (last consignment) at site/stores whichever is earlier plus 3 months towards claim period. Upon submission of the performance security, the EMD shall be released.

 Upon submission of the performance security, the EMD shall be released. It shall be in
 - Upon submission of the performance security, the EMD shall be released. It shall be in accordance with one of the following terms:
- a) Depositing pay order /demand draft of the relevant amount directly with BRPL at the address listed above or as otherwise specified by BRPL, either of which shall constitute the Performance Bond hereunder; or
- b) Bank guarantee from any nationalized bank in favour of BSES RAJDHANI POWER LTD (BRPL). The performance Bank guarantee shall be in the format as specified by BRPL.

13.0 Forfeiture

NIT No.: CMC/BR/23-24/RB/PR/RJ/1149

13.01 Each Performance Bond established under Clause 10.0 shall contain a statement that it shall be automatically and unconditionally forfeited without recourse and payable against the presentation by BRPL of this Performance Bond to the ICICI Bank at Mumbai, or to the



relevant company/ correspondent bank referred to above, as the case may be, together with a simple statement that supplier has failed to comply with any term or condition set forth in the Contract.

13.02 Each Performance Bond established under will be automatically and unconditionally forfeited without recourse if BRPL in its sole discretion determines that supplier has failed to comply with any term or condition set forth in the contract.

14.0 Release

All Performance Bonds will be released without interest within seven (7) days from the last date up to which the Performance Bond has to be kept valid (as defined in Clause 10.0) except for the case set forth in Clause 21.0.

15.0 Defects Liability Period

15.01 The bidder to Guarantee the materials / items supplied against any defect of failure, which arise due to faulty materials, workmanship or design for the entire defects liability period. The Defect liability period shall be 60 months from the date of commissioning or 66 months from the date of delivery whichever is earlier. If during the defects liability period any materials / items are found to be defective, these shall be replaced or rectified by the bidder at his own cost within 30 days from the date of receipt of intimation

16.0 Return, Replacement or Substitution.

BRPL shall give Supplier notice of any defective Commodity promptly after becoming aware thereof. BRPL may in its discretion elect to return defective Commodities to Supplier for replacement, free of charge to BRPL, or may reject such Commodities and purchase the same or similar Commodities from any third party. In the latter case BRPL shall furnish proof to Supplier of the cost of such substitute purchase. In either case, all costs of any replacement, substitution, shipping, labour and other related expenses incurred in connection with the return and replacement or for the substitute purchase of a Commodity hereunder should be for the account of Supplier. BRPL may set off such costs against any amounts payable by BRPL to Supplier. Supplier shall reimburse BRPL for the amount, if any, by which the price of a substitute Commodity exceeds the price for such Commodity as quoted in the Bid.

17.0 Effective Date of Commencement of Contract:

17.01 The date of the issue of the Letter of Acceptance shall be treated as the effective date of the commencement of Contract.

18.0 Time – The Essence of Contract

18.01 The time and the date of completion of the "Supply" as stipulated in the Letter Of Acceptance / Purchase order issued to the Supplier shall be deemed to be the essence of the "Contract". The Supply has to be completed not later than the aforesaid Schedule and date of completion of supply.

19.0 The Laws and Jurisdiction of Contract:



- 19.01 The laws applicable to this Contract shall be the Laws in force in India.
- 19.02 All disputes arising in connection with the present Contract shall be settled amicably by mutual consultation failing which shall be finally settled as per the rules of Arbitration and Conciliation Act, 1996 at the discretion of Purchaser. The venue of arbitration shall be at Mumbai in India

20.0 Events of Default

- 20.01 Events of Default. Each of the following events or occurrences shall constitute an event of default ("Event of Default") under the Contract:
- a) Supplier fails or refuses to pay any amounts due under the Contract;
- b) Supplier fails or refuses to deliver Commodities conforming to this RFQ/ specifications, or fails to deliver Commodities within the period specified in P.O. or any extension thereof
- c) Supplier becomes insolvent or unable to pay its debts when due, or commits any act of bankruptcy, such as filing any petition in any bankruptcy, winding-up or reorganization proceeding, or acknowledges in writing its insolvency or inability to pay its debts; or the Supplier's creditors file any petition relating to bankruptcy of Supplier;
- d) Supplier otherwise fails or refuses to perform or observe any term or condition of the Contract and such failure is not remediable or, if remediable, continues for a period of 30 days after receipt by the Supplier of notice of such failure from BRPL.

21.0 Consequences of Default.

- a) If an Event of Default shall occur and be continuing, BRPL may forthwith terminate the Contract by written notice.
- b) In the event of an Event of Default, BRPL may, without prejudice to any other right granted to it by law, or the Contract, take any or all of the following actions;
- i) present for payment to the relevant bank the Performance Bond;
- ii) purchase the same or similar Commodities from any third party; and/or
- iii) recover any losses and/or additional expenses BRPL may incur as a result of Supplier's default.

22.0 Penalty for Delay

- 22.01 If supply of items / equipments is delayed beyond the supply schedule as stipulated in purchase order then the Supplier shall be liable to pay to the Purchaser as penalty for delay, a sum of 1% (one percent) of the contract price for every week delay or part thereof for undelivered quantities.
- 22.02 The total amount of penalty for delay under the contract will be subject to a maximum of ten percent (10%) of the contract price for undelivered quantities.



22.03 The Purchaser may, without prejudice to any method of recovery, deduct the amount for such damages from any amount due or which may become due to the Supplier or from the Performance Bond or file a claim against the supplier.

23.0 Force Majeure

23.01 General

An "Event of Force Majeure" shall mean any event or circumstance not within the reasonable control directly or indirectly, of the Party affected, but only if and to the extent that:

- i) Such event or circumstance materially and adversely affects the ability of the affected Party to perform its obligations under this Contract, and the affected Party has taken all reasonable precautions, due care and reasonable alternative measures in order to prevent or avoid the effect of such event on the affected party's ability to perform its obligations under this Contract and to mitigate the consequences thereof.
- ii) For the avoidance of doubt, if such event or circumstance would not have materially and adversely affected the performance of the affected party had such affected party followed good industry practice, such event or circumstance shall not constitute force majeure.
- iii) Such vent is not the direct or indirect result of the failure of such Party to perform any of its obligations under this Contract.
- iv) Such Party has given the other Party prompt notice describing such events, the effect thereof and the actions being taken in order to comply with above clause.
- 23.02 Specific Events of Force Majeure subject to the provisions of above clause, Events of Force Majeure shall include only the following to the extent that they or their consequences satisfy the above requirements:
- 23.03 Mitigation of Events of Force Majeure Each Party shall:

- i) Make all reasonable efforts to prevent and reduce to a minimum and mitigate the effect of any delay occasioned by an Event of Force Majeure including recourse to alternate methods of satisfying its obligations under the Contract;
- ii) Use its best efforts to ensure resumption of normal performance after the termination of any Event of Force Majeure and shall perform its obligations to the maximum extent practicable as agreed between the Parties; and
- iii) Keep the other Party informed at regular intervals of the circumstances concerning the event of Force Majeure, with best estimates as to its likely continuation and what measures or contingency planning it is taking to mitigate and or terminate the Event of Force Majeure.
- 23.04 Burden of Proof In the event that the Parties are unable in good faith to agree that a Force Majeure event has occurred to an affected party, the parties shall resolve their dispute in accordance with the provisions of this Agreement. The burden of proof as to whether or not a



force majeure event has occurred shall be upon the party claiming that the force majeure event has occurred and that it is the affected party.

- 23.05 Termination for Certain Events of Force Majeure. If any obligation of any Party under the Contract is or is reasonably expected to be delayed or prevented by a Force Majeure event for a continuous period of more than 3 months, the Parties shall promptly discuss in good faith how to proceed with a view to reaching a solution on mutually agreed basis. If a solution on mutually agreed basis cannot be arrived at within a period of 30 days after the expiry of the period of three months, the Contract shall be terminated after the said period of 30 days and neither Party shall be liable to the other for any consequences arising on account of such termination.
- 23.06 Limitation of Force Majeure event. The Supplier shall not be relieved of any obligation under the Contract solely because cost of performance is increased, whether as a consequence of adverse economic consequences or otherwise.
- 23.07 Extension of Contract Period due to Force Majeure event The Contract period may be extended by mutual agreement of Parties by way of an adjustment on account of any period during which an obligation of either Party is suspended due to a Force Majeure event.
- 23.08 Effect of Events of Force Majeure. Except as otherwise provided herein or may further be agreed between the Parties, either Party shall be excused from performance and neither Party shall be construed to be in default in respect of any obligations hereunder, for so long as failure to perform such obligations shall be due to and event of Force Majeure."

24.0 Transfer And Sub-Letting

24.01 The Supplier shall not sublet, transfer, assign or otherwise part with the Contract or any part thereof, either directly or indirectly, without prior written permission of the Purchaser.

25.0 Recoveries

25.01 Whenever under this contract any money is recoverable from and payable by the bidder, the purchaser shall be entitled to recover such sum by appropriating in part or in whole by detecting any sum due to which any time thereafter may become due from the supplier in this or any other contract. Should the sum be not sufficient to cover the full amount recoverable the bidder shall pay to the purchaser on demand the remaining balance.

26.0 Waiver

26.01 Failure to enforce any condition herein contained shall not operate as a waiver of the condition itself or any subsequent breach thereof.

27.0 Indemnification

NIT No.: CMC/BR/23-24/RB/PR/RJ/1149

27.01 Notwithstanding contrary to anything contained in this RFQ, Supplier shall at his costs and risks make good any loss or damage to the property of the Purchaser and/or the other Supplier engaged by the Purchaser and/or the employees of the Purchaser and/or employees of the other Supplier engaged by the Purchaser whatsoever arising out of the negligence of the Supplier while performing the obligations under this contract.



SECTION – IV: QUANTITY AND DELIVERY REQUIREMENT

S1.	Item Description	Specification	Requirement	Delivery	
No.				Schedule	Location
		BRPL,DELHI			
1	Procurement of Various ratings of Oil Type DT	SECTION V	105 Nos	In lots within 2 months from	Stores BRPL
	TOTA	the date of drawing approval	Delhi		



Annexure -I

BID FORM

Supply of Various Ratings of Oil Type DT

NIT No.: CMC/BR/23-24/RB/PR/RJ/1149

To

Head of the Department Contracts & Materials BSES Rajdhani Power Ltd BSES Bhawan, Nehru Place New Delhi– 110019 Sir.

We understand that BRPL is desirous of procuring "Various Ratings of Oil Type DT" in its licensed distribution network area in Delhi. Having examined the Bidding Documents for the above named works, we the undersigned, offer to deliver the goods in full conformity with the Drawings, Conditions of Contract and specifications for the sum of <u>AS PER PRICE BID ENCLOSED</u> or such other sums as may be determined in accordance with the terms and conditions of the contract .The above amounts are in accordance with the Price Schedules attached herewith and are made part of this bid.

If our Bid is accepted, we undertake to deliver the entire goods as per delivery schedule given by you from the date of award of purchase order/letter of intent.

If our Bid is accepted, we will furnish a performance bank guarantee for an amount of 10% (Ten) percent of the total contract value for due performance of the Contract in accordance with the General Conditions of Contract.

We agree to abide by this Bid for a period of 120 days from the date fixed for bid opening under clause 9.0 of GCC, and it shall remain binding upon us and may be accepted at any time before the expiration of that period.

We declare that we have studied the provision of Indian Income Tax Law and other Indian Laws for supply of equipments/materials and the prices have been quoted accordingly.

Unless and until Letter of Intent is issued, this Bid, together with your written acceptance thereof, shall constitute a binding contract between us.

We understand that you are not bound to accept the lowest, or any bid you may receive.

There is provision for Resolution of Disputes under this Contract, in accordance with the Laws and Jurisdiction of Contract, Clause 19 of GCC.

Dated this	day of	••••	20	
	In th			
•	orized to sign for and			



Annexure -II

FORMAT FOR EMD BANK GUARANTEE

(To be issued in a Non Judicial Stamp Paper of Rs. 50/-purchased in the name of the bank)
Whereas [name of the Ridder] (hereinafter called the "Ridder") has submitted its bid dated

Whereas [name of the Bidder] (hereinafter called the "Bidder") has submitted its bid dated [date of submission of bid] for the supply of [name and/or description of the goods] (hereafter called "the Bid"). KNOW ALL PEOPLE by these presents that WE [name of bank]at[Branch Name and address],having our registered office at[address of the registered office of the bank](herein after called —"the Bank"),are bound unto BSES Rajdhani Power Ltd., with its Corporate Office at BSES Bhawan Nehru Place, New Delhi -110019, (herein after called —the "Purchaser") in the sum of ______ for which payment well and truly to be made to the said Purchaser, the Bank binds itself, its successors, and assigns by these presents. Sealed with the Common Seal of the said Bank this _____ day of __ 20 __.

THE CONDITIONS of this obligation are:

If the Bidder withdraws its Bid during the period of bid validity specified by the Bidder on the Bid Form; or

If the Bidder, having been notified of the acceptance of its Bid by the Purchaser during the period of bid validity:

fails or refuses to execute the Contract Form, if required; or fails or refuses to furnish the performance security, In accordance with the Instructions to Bidders/GENERAL CONDITIONS.;

We undertake to pay to the Purchaser up to the above amount upon receipt of its first written demand, without the Purchaser having to substantiate its demand, provided that is its demand the purchaser will note that amount claimed by it is due to it, owing to the occurrence of one or both of the two conditions, specifying the occurred condition or conditions.

This guarantee will remain in force up to and including thirty (30) days after the period of bid validity, and any demand in respect thereof should reach the Bank not later than the above date.

(Signature of the bank)
Signature of the witness



Annexure-III

PRICE FORMAT

ENQUIRY NO & DATE: NIT: CMC/BR/23-24/RB/PR/RJ/1149

PRICE SCHEDULE

ITEM	QTY	UOM	EX-	CGST	CGST	SGST	SGST	IGST	IGST	FREIGHT	LANDED	TOTAL
DESCRIPTION	AS		WORKS	(%)	AMOUNT	(%)	AMOUNT	(%)	AMOUNT		RATE/	LANDED
	PER		RATE/								UNIT	COST
	RFQ		UNIT								01111	(INR)
	KIQ		UNII									(IINK)
25 kVa Oil Type DT	36	Nos										
50 kVa Oil Type DT	53	Nos										
63 kVa Oil Type DT	04	Nos										
100 kVa Oil Type DT	12	Nos										
			1		l	1		1	l		1	l

Note: 1.Prices shall be Firm

- 2. The prices received without break up of ex works, Freight, GST are liable for rejection
- 3. Pls. Indicate the exact percentage of taxes in figures and words.
- 4. If there is a discrepancy between the unit price and the total price THE UNIT PRICE shall prevail.
- 5. Bidders are requested to attach the covering letter head alongwith the price bid indicating reference no and date.

Bidders seal & signature



Annexure - IV

Enquiry No. : CMC/BR/23-24/RB/PR/RJ/1149

NIT No.: CMC/BR/23-24/RB/PR/RJ/1149

COMMERCIAL TERMS AND CONDITIONS

S/NO	ITEM	AS PER BRPL	CONFIRMATION
	DESCIPTION		OF BIDDER
1	Validity of prices	120 days from date of offer	
2	Price basis	Price Variation, FOR Delhi store basis, Prices shall be inclusive of all taxes & duties, freight upto Delhi stores. Unloading at stores be in vendor's scope Transit insurance in BRPL scope	
3	Payment Terms	100% payment within 45 days after receipt of material at stores	
4	Delivery schedule	As per our requirement	
5	Defect Liability Period	The bidder to Guarantee the materials / items supplied against any defect of failure, which arise due to faulty materials, workmanship or design for the entire defects liability period. The Defect liability period shall be 60 months from the date of commissioning or 66 months from the date of delivery whichever is earlier. If during the defects liability period any materials / items are found to be defective, these shall be replaced or rectified by the bidder at his own cost within 30 days from the date of receipt of intimation.	
6	Penalty for delay	1% per week of delay of undelivered units or part thereof subject to maximum of 10% of total PO value of undelivered units	
7	Performance Bank Guarantee	10% of total PO value for 24 months after commissioning or 30 months from date of supply, whichever is earlier plus 3 months towards claim period	



ANNEXURE - V

ENQUIRY NO: CMC/BR/23-24/RB/PR/RJ/1149

NO DEVIATION SHEET

SL NO	SL NO OF TECHNICAL SPECIFICATION	DEVIATION, IF ANY

SIGNATURE & SEAL OF BIDDER

NIT No.: CMC/BR/23-24/RB/PR/RJ/1149

NAME OF BIDDER



CHECK LIST

Sl No	Item Description	YES/NO
1	INDEX	YES/NO
2	COVERING LETTER	YES/NO
3	BID FORM (UNPRICED) DULY SIGNED	YES/NO
4	BILL OF MATERIAL (UNPRICED)	YES/NO
5	TECHNICAL BID	YES/NO
6	ACCEPTANCE TO COMMERCILAL TERMS & CONDITIONS	YES/NO
7	FINANCIAL BIDS (IN SEALED ENVELOPE)	YES/NO
8	EMD IN PRESCRIBED FORMAT	YES/NO
9	DEMANT DRAFT OF RS 1180/- DRAWN IN FAVOUR OF	BSES RAJDHANI POWER LTD
10	POWER OF ATTORNEY/ AUTHORISATION LETTER FOR SIGNING THE BID	YES/NO



Annexure III

NIT No.: CMC/BR/23-24/RB/PR/RJ/1149

FORM FOR PARTICIPATION IN REVERSE AUCTION EVENT

(To be signed & stamped by the bidder along-with bid)

BSES Rajdhani Power Ltd (BRPL) intends to use reverse auction through SAP-SRM tool as an integral part of entire tendering process. All bidders who are technocommercially qualified on the basis of tender requirements shall participate in the reverse auction.

The following terms and conditions are deemed as accepted by the bidder on participation in the bid:-

- 1. In case of bidding through Internet medium, bidders are advised to ensure availability of all associated infrastructure as required to participate in the reverse auction event. Inability to bid due to telephone glitch, internet response issues, software & hardware hangs/failures, power failures or any other reason shall not be the responsibility of BRPL.
- 2. In case bidder fails to participate in the reverse auction event due to any reason whatsoever, it shall be presumed that the bidder has no further discounts to offer and the initial bid submitted by them as a part of tender shall be considered as bidder's Final .No Regret offer.Any off-line price bids received from a bidder in lieu of non-participation in the reverse auction event shall be rejected by BRPL.
- 3. The bidder is advised to understand the auto bid process t safeguard themselves against any possibility of non-participation in the reverse auction event.
- 4. The bidder shall be prepared with competitive price quotes during the day of reverse auction event.
- 5. The prices quoted by bidder in reverse auction event shall be on FOR Landed cost BRPL Store/site basis inclusive of all relevant taxes, duties, levies, transportation charges etc.
- 6. The prices submitted by the bidder during reverse auction event shall be binding on the bidder.
- 7. The bidder agrees to non-disclosure of trade information regarding bid details e.g.purchase, identity, bid process/technology, bid documentation etc.
- 8. BRPL will make every effort to make the bid process transparent. However award decision of BRPL will be final and binding on the bidder.
- 9. The prices submitted during reverse auction event shall be binding on the bidder.
- 10. No request for Time extension of the reverse auction event shall be considered by BRPL.



Seal & Signature of Bidder

NIT No.: CMC/BR/23-24/RB/PR/RJ/1149

SECTION – V TECHNICAL SPECIFICATIONS (TS)

VARIOUS RATINGS OF OIL TYPE DT IN BRPL

CMC/BR/23-24/RB/PR/RJ/1149

The detailed technical specifications of Various Ratings of Oil Type DT



TECHNICAL SPECIFICATIONS FOR

THREE PHASE OIL TYPE DISTRIBUTION TRANSFORMER

25 KVA TO 100 KVA

Specification no - BSES-TS-62-TPDT-R0

Revision		0
Date		13/06/2022
Pages		42
200	Jeena Borana	Jung
Prepared by	Vani Sood/ Pronab Bairagi	randed or 15/15/2022
	Srinivas Gopu	for Rivery
Reviewed by	Amit Tomar	Side
Approved by	Gaurav Sharma	eaway)
	Gopal Nariya	The state of the s



CONTENTS

- 1 SCOPE
- 2 CODES AND STANDARDS
- 3 DESIGN
- 4 QUALITY ASSURANCE
- 5 INSPECTION AND TESTING
- 6 PACKING, SHIPPING, HANDLING AND STORAGE
- 7 INSPECTION EXPENSES
- 8 APPENDICES
- 1 APPENDIX A: LIST OF APPLICABLE CODES AND STANDARDS
- 2 APPENDIX B: DRAWING SUBMITTAL REQUIREMENTS OF THE SUPPLIER
- 9 **ANNEXURES**
- 1 ANNEXURE I: DATA SHEET OF CLIENT REQUIREMENT
- 2 ANNEXURE II: VENDOR DATA
- 3 ANNEXURE-III: TRANSFORMER OIL
- 4 ANNEXURE-IV: CRGO & TESTING POINTS



Record of Revision

S.No.	Revision No	Item/Clause No.	Nature of change	Approved by



1.0 SCOPE

- 1.1 This specification covers design, engineering, manufacturing, assembly, testing at manufacture's works, packing, transportation and delivery to store and submission of complete documentation for three phase conventional oil filled distribution transformer of rating 25 to 100KVA rating.
- 1.2 The transformer shall be complete with all components and accessories, which are necessary or usual for their efficient performance and trouble free operation under the various operating and atmospheric conditions specified in Annexure I: Data sheet of client requirement.
- 1.3 Such of the parts that may have not been specifically included, but otherwise form part of the transformer as per standard trade and/or professional practice and/or are necessary for proper operation of transformer, will be deemed to be also included in this specification. The successful bidder shall not be eligible for any extra charges for such accessories etc. notwithstanding the fact that at the time of an initial offer bidder had segregated such items and quoted for them separately.

2. CODES AND STANDARDS

- 2.1 All equipment and material shall be designed, manufactured and tested in accordance with the latest applicable Indian Standards, IEC standard and CBIP manuals enlisted in the Appendix-A, except where modified and / or supplemented by this specification.
- **2.2** Equipment and material conforming to any other standard, which ensures equal or better quality, may be accepted. In such case copies of English version of the standard adopted shall be submitted by the vendor with the offer.
- 2.3 The electrical installation shall meet the requirement of Indian Electricity Rules as amended up to date, relevant IS code of practice and Indian electricity act. In addition other rules & regulations applicable to the work shall be followed. In case of any discrepancy, the most stringent & restrictive one shall be binding.
- 2.4 The equipment offered shall in general comply with the latest issues including amendments of the standards enlisted in Appendix-A but not restricted to it.
- 2.5 Vendor shall possess valid BIS Certification.

3. **DESIGN**

The design and workmanship shall be in accordance with the best engineering practices to ensure satisfactory performance throughout the service life. The features and construction



details of each transformer shall be in accordance with the requirements stated herein under.

3.1 APPLICATION

The transformers are intended to be used for normal operation in Delhi Distribution system for making available three phase and/or single phase supply to the consumers at voltage as indicated in Annexure-I.

3.2 RATINGS

The transformer shall be of rating as indicated in Annexure-I.

3.3 NORMAL SITE CONDITIONS

The distribution transformers to be supplied against this Specification shall be suitable for satisfactory continuous operation under the conditions as per Annexure-I: Data sheet of client requirement.

3.4 TRANSFORMER TANK

- 3.4.1 The Transformer tank shall be of plain rectangular / octagonal and made of good quality sheet steel of adequate thickness suitably stiffed to provide sturdy and robust construction to withstand extreme pressure conditions. The tank shall be capable of withstanding pressure as per values specified in IS: 1180 (Part I) in Appendix-A for non-sealed type Transformers.
- 3.4.2 The tank cover shall have plasticized surface at the top to guard against bird age faults. Alternatively, suitable insulating shrouds shall be provided on the bushing terminals.
- 3.4.3 Steel surface of the tank shall be prepared by sand/shot blast or chemical cleaning including phosphating as per IS: 3618
- 3.4.4 Heat resistance paint (Hot oil proof) shall be provided inside the tank.
- 3.4.5 On external surfaces two coats of zinc chromate primer followed by two coats of anticondensation type polyurethane paint, having minimum dry film thickness of 80 microns. Paint of shade conforming to No.632, Adminarly grey shade of IS-5 of 1961 as in Annexure-1 shall be provided.
- 3.4.6 The transformer shall have a self-pressure venting system.

3.5 BUSHING AND TERMINALS

Page 5 of 42



- 3.5.1 All bushings shall be porcelain clad, and shall be sealed to prevent ingress of moisture and to facilitate removal. The HV bushings shall be fitted with moulded heat shrinkage insulating covers suitable for bare overhead conductor / Aerial bunched cables / U/G cables.
 - The HV Bushing shall be of open type terminal and LV Terminals shall be inside the Cable Box. The bushing stems/terminals for all HV phases, made of suitable copper alloy shall be so designed as to directly receive aluminium stranded overhead conductors with bolted type clamping arrangement both in horizontal and vertical directions. In case of copper/copper alloy stems, suitable bimetallic clamps with bolted type arrangement described above shall be used. If HT Underground Cables or Aerial bunched cables are used, then all the terminals shall be connected with suitable Al. lugs. Bimetallic washers shall be provided in between connection of Copper and Aluminium conductors.
- 3.5.2 LV cable box shall be provided with the proper facilities for taking out 3 phase and neutral supplies to the LV distribution board. Additional neutral terminal bushing shall be made available on the cable box for connection to separate earth.
- 3.5.3 For 25kVA & 63KVA transformer LV Cable box shall be with inbuilt, insulated bus bar with MCCB of appropriate ratings with 25kA breaking current capacity). All covers and flanges and joints shall be fixed by secure tamper- proof anti-theft fasteners with following features:
 - i. All the fasteners shall be of secure anti-theft design with special non-standard/rare drive head slots and round head such that they cannot be tightened or removed with a regular wrench.
 - ii. Head slots of shape "plus", "minus", or "allen (hexagonal)" shall not be used, as drive wrenches for such head slots are readily available in market.
 - iii. Special drive bit or wrench or key Special driver bit or wrench or key, one no. per transformer, shall be supplied to tighten or remove such secure fasteners
- 3.5.4 Suitable gland plate, cable glands and lugs as required shall be supplied with the cable box.

3.6 CONSERVATOR

- 3.6.1 In the distribution transformers of 63 and 100 kVA, rating the provisions of conservator is mandatory and for 25 kVA transformers the manufacturers may adopt their standard practices.
- 3.6.2 When a conservator is fitted, the conservator shall be provided with a drain plug and a filling hole with a cover. In addition, the cover of the main tank shall be provided with an air release plug to enable trapped air to be released unless the conservator is so located as to eliminate the possibility of air being trapped within the main tank.
- 3.6.3 The inside diameter of the pipe connecting the conservator to the main tank shall be within 20 to 50 mm and it should projected into the conservator so that its end is approximately 20 mm above Page 6 of 42



the bottom of the conservator, so as to create a sump for collection of impurities. The minimum oil level (corresponding to –5deg. C) should be above the sump level.

3.7 FITTINGS

The following standard fittings shall be provided for both sealed and non-sealed type transformers.

- a) Two earthing terminals with facility to connect 50x6 MM GI Strip. The terminals Shall be located on the lower side of the transformer and be of M12 size. Each shall be clearly indicated with an engraved 'Earth' symbol.
- b) Two Nos heavy duty lifting lugs.
- c) Rating and terminal marking plate(s) as per this specification and IS 1180 part 1
- d) Plain breathing device comprising an inverted U-pipe with wire gauze at the open end (to prevent entry of insects). Silica gel breather or any other type of breather as required.
- e) Drain-cum-sampling valve (steel) welded to the tank. Special tool for operating this valve shall be supplied with the transformer. All valves shall have locking arrangement.
- f) Oil filling hole, with cover having 1-1/4" nominal size threads on the transformers body/conservator.
- g) Oil level gauge indicating oil levels.
- h) Thermometer pocket with cap.
- i) Terminal connectors.
- j) Pressure relief device or explosion vent.
- k) Dial Type thermometer working as OTI for 100 KVA
- I) CT Terminal Box for all the ratings.
- m) MOG to be provided with 2(NO+NC) for trip and alarm-with aux contact wired up to separate terminal box for 100 KVA

3.8 CORE AND WINDINGS

- 3.8.1 The core shall be constructed from high grade cold rolled, non-ageing, grain oriented silicon sheet steel and shall be properly annealed to relieve stresses.
 - Core shall be in the form of step and stack in three limb format.

Note: No wound core shall be acceptable

- 3.8.2 The HV and LV windings for these transformers shall be wound using high conductivity Copper of electrolytic grade for above 25KVA to 100KVA Transformers and high conductivity Aluminium of electrolytic grade for 25KVA & 63KVA Transformer.
 - Type of winding LV: Spiral/ Helical HV: Crossover/Disc

Note: No foil winding shall be acceptable

Page 7 of 42



- 3.8.3 DPC insulation shall be used for HV and LV winding wires and electrical grade plain insulation Kraft paper for interleaving, no material which can be deleteriously affected by the action of oil under the operating conditions of the transformers shall be used in the transformers or leads of the bushings.
- 3.8.4 The core and coil assembly shall be securely held in position to avoid any movement under short- circuit conditions.
- 3.8.5 All turns of windings shall be adequately supported to prevent movement, in cases where turns are spaced out, a suitable inter-turn packing shall be provided. The insulation between core and bolts and core & clamps shall be suitable for withstanding 2000 Volts minimum, for one minute.

3.8.6 Winding Connections

The primary winding shall be connected in delta and the secondary winding in star (Vector Symbol Dyn11), so as to produce a positive displacement of 30° from the primary to the secondary vector of the same phase. The neutral of the secondary winding shall be connected to a separate insulated terminal.

Off circuit taps shall be provided on HV winding with tapings of +2.5% to -5% (4 Nos. taps in steps of +2.5%, 0, -2.5% & -5%) etc. Tapping switch shall only be provided for 100KVA transforms.

3.9 **TAPS**

The tap switch shall be of rotary type with operating voltage of 11KV & continuous current rating of 60Amps for 100KVA rating transformer.

3.10 MOUNTING ARRANGEMENT

The transformers are to be mounted on MS channel on PCC pole DP structure or steel pole DP structure. The transformer therefore shall be provided with suitable and robust mounting arrangement. The under base of transformer shall be provided with two nos. 75 x 40mm MS channel, 460mm long with slots/holes 18 mm x 21mm for fixing on a platform on plinth. The mounting arrangement drawing shall be furnished for approval.

3.11 RATING AND TERMINAL MARKING PLATE

The transformer shall be provided with non-detachable rating marking plate / Diagram plate(s) of non-corroding, weather proof material, fitted in a visible position and showing the complete information as in IS: 1180 (Part - I). Rating plate shall also include Transformer Actual



%Z,No-LoadLoss & Full-LoadLoss at 75°C and total losses (No load losses + load losses at 75°C) at 50 % of rated load and at 100 % of rated load along with details like PO No, date, name of the company BSES. The name plate marking shall be done with fluorescent colour. Serial No. of the transformer shall be written with fluorescent paint on the body of each transformer so that the same can be read from the ground.

3.12 LIMITS OF TEMPERATURE RISE

The temperature rise over the maximum ambient temperature of 50°C shall not exceed the limits of 40°C (measured by resistance) for transformer windings and 35°C (measured by thermometer) in top oil, when tested in accordance with IS: 2026.

3.13 LOSSES AND IMPEDENCE VALUES

• The total losses (no load and load losses at 75 °C) at 50% and 100% of rated load shall not exceed the maximum total load values given in below table.

	Maximum total losses (Watts)	
KVA	50 % load	100 % load
25	190	635
63	340	1140
100	475	1650

These losses are maximum allowable and there would not be any plus tolerance.

• The percentage impedance at 75o C shall be 4.5% with IS tolerances as per IS 1180.

3.14 OVERFLUXING

The transformer shall be suitable for over fluxing (due to combined effect of voltage and frequency) up to 12.5%, without injurious heating or saturation at full load conditions. The maximum flux density in any part of the core under such condition shall not exceed 1.9 Tesla. The supplier shall furnish necessary design data in support of this stipulation.

3.15 TRANSFORMER OIL

 It Should be in accordance with specification as per Annex III of this document One sample of oil drawn from every lot of transformer offered for final inspection should
 Page 9 of 42



be tested at CPRI/ERDA for tests as listed in IS 1866.

- Sample for oil testing shall be drawn from any transformer (chosen by BSES) from each offered lot after conducting acceptance tests during final inspection of the offered lot.
- The cost of this testing shall be borne by the transformer manufacturer.
- 10% extra oil to be furnished in separate nonreturnable drum with each transformer

4.0 QUALITY ASSURANCE

4.1 General

The Supplier shall adopt suitable quality assurance program and procedures to ensure that all activities are being controlled as necessary. The Supplier shall indicate following in the quality assurance plan – **Hold Point** "A stage in the material procurement or workmanship process beyond which work shall not proceed without the documented approval of designated individuals or organizations."

The Purchaser's written approval is required to authorize work to progress beyond the Hold Points indicated in approved quality plans.

Notification Point "A stage in material procurement or workmanship process for which advance notice of the activity is required to facilitate witness." If the Purchaser does not attend after receiving documented notification in accordance with the agreed procedures and with the correct period of notice then work may proceed.

4.2 Quality Plans

The Supplier shall draw up for each section of the work quality plans which shall be submitted to the Purchaser for approval at least two weeks prior to the commencement of work on the particular section. Each quality plan shall set out the activities in a logical sequence and, unless advised otherwise, shall include the following:

- An outline of the proposed work and programme sequence
- The structure of the Supplier's organisation for the contract
- The duties and responsibilities assigned to staff ensuring quality of work for the contract
- Hold and notification points
- Submission of engineering documents required by the specification
- The inspection of materials and components on receipt
- Reference to the Supplier's work procedures appropriate to each activity
- Inspection during fabrication/construction
- Final inspection and test

4.3 Sub-suppliers

The Supplier shall ensure that the quality assurance requirements of this specification are

Page 10 of 42



followed by any sub-suppliers appointed by him under the Contract.

The Supplier shall assess the sub-supplier's quality assurance arrangements prior to his appointment to ensure compliance with the specification.

Auditing of the sub-supplier's quality assurance arrangements shall be carried out by the Supplier and recorded in such a manner that demonstrates to then Purchaser the extent of the audits and their effectiveness.

4.4 Warranty

The Supplier shall warranty the following:

- Quality and strength of materials used.
- Satisfactory operation during the warranty period of 60 months from the date of commissioning, or 66 months from the date of delivery of the material at BSES store, whichever is earlier.
- Performance figures as supplied by the Bidder in the schedule of guaranteed particulars.
- The offered surface treatment shall protect the treated metal from corrosion for a period of not less than five years from the date of delivery.

5.0 INSPECTION AND TESTING

5.1 INSPECTION

- 5.1.1 The manufacture shall carry out comprehensive inspection and testing during manufacturing of the transformer.
- 5.1.2 The manufacturer shall carry out all type tests and routine tests on the transformer and special test if required any, shall be carried out as per IS by mutual arrangement between purchaser and supplier. The charges, if any, for conducting each of the type tests and special tests shall be indicated separately in the tender.
- 5.1.3 The purchaser reserves the rights to waive off certain or all tests.
- 5.1.4 All external components and fittings that are likely to affect the performance of the transformer during the test shall be in its place.

5.2 TESTS



Following tests are to be conducted by the vendors in the presence of BSES representative, Please note that without BSES clearance, vendor shall not proceed with manufacturing at any stage of work,

5.2.1 CORE TEST

Core cutting and testing to be witnessed by BSES representative in accordance with annexure-IV. One sample of CRGO sheet to be sealed for testing at ERDA/CPRI once per P.O. (applicable for 100 KVA only)

Following Tests shall be conducted on the sample:

- Specific core loss measurement
- Magnetic polarization
- Magnetic permeability
- · Specific core loss measurement after accelerated ageing test
- Surface insulation resistivity
- Electrical resistivity measurement
- · Stacking factor
- Ductility(Bend test)
- Lamination thickness
- Magnetization characteristics (B-H curve)

5.2.2 STAGE INSPECTION

All winding, core assembly, core-coil assembly and tank shall be witnessed, checked and verified by BSES representative in accordance with annexure-V at manufacturer's works.

5.2.3 ROUTINE & ACCEPTANCE TESTS:

All transformers shall be witnessed, checked and verified by BSES representative to the following routine tests at the manufacturer's works and in accordance with IS: 2026 and IS: 1180 (Part – I & II, Appendix-A) and shall be deemed to be included in the supplier's scope:

- Measurement of winding resistance at all taps.
- Measurement of voltage ratio and check of voltage vector relationship at all taps
- Measurement of impedance voltage/short-circuit impedance and load loss at 50 % &100 % of load.
- Measurement of no-load loss and no load current
- Measurement of insulation resistance and polarization index.
- Magnetic balance test.
- Induced over voltage withstand test
- · Separate source voltage withstand test

Page 12 of 42

_



- · Oil breakdown voltagetest.
- · Over voltage withstand capability Test.
- Pressure test
- Oil leakage test
- Temperature rise test(To be conducted on lowest tap)

5.2.4 TYPE TESTS

Following type tests shall be conducted as per IS

- Lightning impulse test
- Heat run test (HRT)
- Short-circuit test (Dynamic short circuit tests & Thermal withstand test for 3 seconds)
- Air Pressure test

Following procedures are to be complied with respect to type tests:

- a) The product offered must be of type tested quality as per relevant IS from. Type test carried out in last five year will be valid.
 - In case type test report is more than 5 years old & less than 10 years old with no change in design, then also it is valid for participation.
 - **Note**: In case bidder has conducted type test from KEMA/PEHLA/CESI, same shall be considered for bid participation
- b) In case the bidder is 1st time participated in BSES, then they have to conduct the type test from CPRI/ERDA on BSES design without any cost implication to BSES.
- c) In case bidder had earlier conducted and having valid type tests report on BSES design/supplies, then they don't need to conduct the type test, In case type test report is more than 5 years old & less than 10 years old with no change in design, then bidder do not need to conduct the type test from CPRI/ERDA
- d) In case type test report is more than 10 years old then bidder has to conduct complete type test from CPRI/ERDA without any cost implication to BSES.

5.2.5 TRANSFORMER OIL TESTING

- Dissolved Gas Analysis (DGA) before and after HeatRun Test (HRT) shall be done on one unit per Purchase order from CPRI/ERDA.
- Complete oil testing as per IS 1866 shall be done on one unit from each lot from CPRI/ERDA.



6 PACKING, SHIPPING, HANDLING AND STORAGE

- Packing shall be sturdy and adequate to protect all assemblies, components and accessories from injury by corrosion, dampness, heavy rains, breakage and vibration encountered during transportation, handling and storage at the plant site. All accessories, which are likely to get damaged during transit if transported mounted on the equipment, shall be removed, adequately packed and shipped separately. All openings shall be sealed. Spare parts shall be packed separately and clearly marked. They shall be specially packed for long storage without injury.
- The bidder shall after proper painting, pack and crate all plant equipment for sea shipment/air freight in a manner suitable for export to a tropical humid and saline air borne climate region as per Internationally accepted export practice in such a manner so as to protect it from damage and deterioration in transit by road, rail and/or sea and during storage at site till the time of erection. The bidder shall be held responsible for all damages due to improper packing.
- 6.3 The bidder shall give complete shipping information concerning the weight, size, contents of each package including any other information the Purchaser may require. The weight and size of the package shall be such that they can be easily transported from the maker's works to the plant site by ship/air, road ways and railways.
- The bidder shall ascertain at an early date and definitely before the commencement of manufacture, any transport limitations such as weights, dimensions, road culverts, overhead lines, free access etc. from the manufacturing plant to the project site; and furnish to the Purchaser confirmation that the proposed packages can be safely transported, as normal or oversize packages, up to the plant site. Any modifications required in the infrastructure and cost thereof in this connection shall be done and borne by the bidder.
- The bidder shall prepare detailed packing list of all packages and containers, bundles and loose materials forming each and every consignment dispatched to 'site'. The bidder shall further be responsible, for making all necessary arrangements for loading, unloading and other handling right from his works; and from Indian port for equipment under the Off-shore Supply till the 'site' and also till the equipment is erected, tested and commissioned. The bidder shall be solely responsible for proper storage and safe custody of all equipment.
 - Each packing case shall be indelibly marked, on two adjacent sides and on the top, with the following:
 - Individual serial number.
 - Purchaser's name.
 - Contract number.
 - Destination.



- A colour coded marking to indicate destination.
- Supplier's name.
- Name and address of Supplier's agent.
- Description and number of contents.
- Manufacturer's name.
- · Country of origin.
- Case measurements.
- · Gross and net weights in kilograms.
- All necessary slinging and stacking instructions.

Each crate or container shall be marked clearly on the outside of the case to show TOP and BOTTOM positions with appropriate signs to indicate where the mass is bearing and the correct positions for slings. Six copies of each packing list shall be sent to the Purchaser prior to dispatching the equipment.

7 INSPECTION EXPENSES

Inspection (i.e. routing test, acceptance test, type test, factory visit etc.) shall be done any time by BSES on the basis of P.O. or may involve 3rd party as per BSES requirement.

Any kind of test (routine/type test/acceptance test if any) at 3rd lab (i.e. CPRI/ERDA/NABL approved lab) shall be carried out by seller at their own cost.



APPENDIX-A

LIST OF APPLICABLE CODES AND STANDARDS

All Material against this specification shall conform in all respect to the relevant Indian standard specification

/ International Standard Specification, with latest amendments from time to time, thereof, some of which are listed below:

Indian Standard	Title	
IS-2026/2011	Specification for Power Transformer	
IS-1180/2014	Outdoor distribution transformer up to and including	
	2500 KVA	
IS-335/2018	Specification for oil	
IS-2099-1986	Specification for High voltage Porcelain Bushings	
IS-7421/1976	Specification for Low voltage Bushings	
IS-3347	Specification for Outdoor Bushings	
IS-12444	Specification for Cu Wire rods	
IS-5484	Specification for Al Wire rods	
IS-5/1961 No. 632	Specification for Colors for ready mixed paints.	
IS-6600/1972	Guide for loading of oil immersed Transformers.	
IS-13947-Part 2	Low voltage switchgear and control gear.	
IS-10028/1985 Code of Practice for Selection, Installation and		
	Maintenance of Transformers.	
IS-5 / 1994	Colours for ready mixed paints and enamels	
IS-3618 / 1966	Specification for phosphate treatment of iron and steel	
	for protection against corrosion	
IEC Standard	Title	
IEC 60296	Specification for unused and reclaimed mineral	
	Insulating oil for transformer and switchgear.	
IEC 60076	Specification for power transformer.	
IEC 60076-1	General	
IEC 60076-2	Specification for temperature rise requirement	
IEC 60076-3	Specification for insulation levels and dielectric tests.	
IEC 60076-4	Specification for tapping and connections	
IEC 60076-5	Specification for ability to withstand short circuit	
IEC 60551	Determination for transformer and reactor sound levels	
IEC 60354	Guide to loading of oil immersed power transformer	
IEC 60137	Insulated bushings for alternating voltage above 1kV	

Page 16 of 42



Other International and Internationally recognized star	Title
BS148, ASTM D-1275 D-1473, D-1533-1934	Specification for oil
DIN 42531 to 33	Specification for Outdoor Bushings
ASTM B-49	Specification for Cu Wire rods
ASTM B-233	Specification for Al Wire rods


Material conforming to other internationally accepted standards, which ensures equal or better quality than the standards mentioned above would be acceptable, subject to prior approval of Owner. In case the Bidders who wish to offer material conforming to the other standards, salient points of difference between the Standards adopted and the specific standards shall be clearly brought out in relevant schedule. Four copies of such standards with authentic English Translation shall be furnished along with the offer. In the case of conflict the order of precedence shall be 1) Indian Standards, 2) IEC Standards, 3) Other alternative standards.

APPENDIX-B

DRAWINGS SUBMITTAL REQUIREMENT OF THE SUPPLIER

Drawings, Data and Manuals shall be submitted with the bid and after the bid in quantities and procedures as specified in this specification for approval and subsequent distribution after the issue of Notice to proceed.

S.No	Description Of Drawing / Data / Manuals	With bid	Post bid	
		(2 sets of hard copies)	For review & approval (2 sets of hard copies)	Prior to Dispatch (2 sets of hard copies and 1 CD-ROM)
1	Completed technical data schedule;	Υ		
2	Descriptive literature giving full technical details of equipment offered;	Υ		





3	Outline dimension drawing for each	Υ		
	major component, general arrangement			
	drawing showing component layout and			
	general schematic diagrams;			
4	Type test certificates, where available,	Υ		
	and sample routine test reports;			
5	Detailed reference list of customers	Υ		
	already using equipment offered during			
	the last 5 years with particular emphasis			
	on units of similar design and rating;			
6	Details of manufacturer's quality	Υ		
	assurance programme and ISO 9000			
	series or equivalent national certification;			
7	vii)Deviationfromthisspecification.Only			
	deviations approved in writing before			
	award of contract shall be accepted			
8	Recommended spare parts and	Υ		
	consumable items for five years of			
	operation with prices and spare parts			
	catalogue with price list for future			
	requirements			
9	Quality Assurance Program	Υ		
10	Programme for production and testing		7	
	(A)			
11	Guaranteed Technical Particulars (A)		7	
12	General description of the equipment		7	



	and all components, including brochures (
	R)		
13	Calculations to substantiate choice of	7	
	electrical, structural, mechanical		
	component size/ratings (A)		
14	Detailed loading drawing to enable the	7	
	buyer to design and construct		
	foundations for the transformer(R)		
15	Transport / shipping dimensions with	7	
	weight, wheel base details, untanking		
	height etc. (R)		
16	Terminal arrangements and cable box	7	
17	Drawings of major components like	7	
	Bushing, Ct etc. (A)		
18	List of makes of all fittings and	7	
	accessories (A)		
19	Statement drawing attention to all	7	
	exposed points in the equipment at		
	which contact with or in closeproximity		
	to other metals and stating clearly what		
	protection is employed to prevent		
	corrosion at each point (A)		
20	Detailed installation and commissioning	7	
	instructions		
21	Quality Plan	7	
22	Inspection and test reports carried out in		Υ
	manufacturer's works (A)		
23	Test certificates of all bought out items		Υ
24	Operation and maintenance Instruction		Υ
	as well as trouble shooting charts /		
	manual		

Legend:

- **Y:** The drawing / document is required from the supplier.
- 7: Within 7 days of LOI / PO / award of contract.
- 'A' \rightarrow Means required for review and approval. 'R'
- $\rightarrow \ \text{Means required for reference only}.$

Page 19 of 42



NOTES:

- The delivery period shall be reckoned from the date of placement of the order and not from the date of approval of drawings. Thus the delay in the submission of drawings for approval shall result in invoking the provisions of the penalty clause and the no. of days by which the delay has occurred shall be reckoned as delay in delivery. Accordingly it is the responsibility of the bidder to ensure that drawings are submitted within the stipulated number of days.
- Two (2) sets of all drawings, data sheets shall be furnished in HARD COPY (with a forwarding letter, listing therein all the documents furnished for review / approval) to the Head Engineering BSES. Drawing submittal by e-mail (soft copies) shall NOT be considered for review.
- Accordingly the entire review / approval cycle shall be completed within 10 working days from the date of receipt of the first submittal from the supplier.



ANNEXURE- I

DATA SHEET OF CLIENT REQUIREMENT

1 Electrical System Data

SI. No.	Continuous rated capacity	25 kVA	63 kVA	100 kVA
1	Location of equipment	_	or but may be located	d indoor also
		with poor ventilat	ion	
1.1	Reference design ambient	50°C		
	temperature			
1.2	Туре		re type, step down	
1.3	Type of cooling	ONAN		
1.4	Tank	As per Clause no		
1.5	Reference standard	IS-1180 & IS: 20	26	
1.6	No. of phases	3		
1.7	No. of windings per phase	2		
1.8	Rated voltage HV	11kV		
1.9	Highest System voltage –H.V	12kV		
1.10	Highest system voltage LV side	476 Volt		
1.11	HV system voltage variation	+/-10%		
1.12	Frequency variation	+/- 5%		
1.13	Combined voltage frequency variations	-20% or +10%		
1.14	Power frequency withstand voltage (kV rms) –H.V	28kV		
1.15	Impulse withstand voltage (kVpeak)- H.V	75kV (peak)		
1.16	Rated voltage LV	415 V		
1.17	Line current HV	1.31A	3.306A	5.25A
1.18	Line current LV	33.33A	84.0A	133.0 A
1.19	% Impedance (at 75°C)	4.5% with IS tole	rance	
1.20	Guaranteed Total Losses			
1.21	Guaranteed Losses(no load +load losses at 75 °C) (watts) @ 50 % rated load	190	340	475



BSES-TS-62-TPDT-R0

1.22	Guaranteed Losses(no load +load	635	1140	1650
	losses at 75 °C) (watts) @ 100 %			
	rated load			
1.22	No. of phases	Three		
1.23	Connection HV	Delta		
1.24	Connection LV	Star with Neutral b	rought out for extern	nal earth
1.25	Vector Group reference	Dyn11		



1.26	No load voltage ratio	11kV/415V
1.27	Max. System fault level at HV Side	500 MVA
3	Short circuit Withstand capacity of the transformer	
3.1	Three phase dead short circuit at secondary terminal with rated voltage maintained on the other side	For 3 sec
3.2	Single phase short circuit at secondary terminal with rated voltage maintained on other side	
4	Noise Level	48/51/51 dB for 25, 63, 100 KVA transformers Respectively.
5	Power frequency withstand voltage kV rms	
5.1	Lighting impulse voltage for nominal system voltage of 11KV	75 KV
5.2	For nominal system voltage of 415V	3 KV
6	Clearances Phase to Phase in mm	
6.1	For nominal system voltage of 11KV	280MM.
6.2	For nominal system voltage of 415V	25 MM.
7	Clearances Phase to earth, Mm	
7.1	For nominal system voltage of 11KV	140 MM
7.2	For nominal system voltage of 415V	25 MM
8	System Fault Level, LV side	35MVA
9	HV	Solidly earthed
9.1	LV	Solidly earthed
10	Maximum overall dimension acceptable (Length x Width x height) mmxmm	(1150 X 1010 X 1380) mm
11	Overload Capability	As per IS 6600
12	Radio Influence Voltage	Maximum 25 microvolt
13	Harmonic suppression	Transformer to be designed for suppression of 3rd, 5th, 7th harmonic voltages and high
14	Partial Discharge	frequency disturbances. Transformer to be free from partial discharge up to 120 % of rated voltage

_



		as the voltage is reduced from 150 % of
		rated voltage i.e. there shall be no
		significant rise above background level
15	Tapping's for 100kVA	Off circuit taps on HV winding,+2.5 to -5% in steps
		of 2.5%, change of taps by externally operated switch
16	Rotary tap switch operating voltage	11Kv
16.1	Rotary tap switch current rating Amp.	60AMP
17	Temperature rise over reference ambient of 50°C	
17.1	Top oil by thermometer ⁰ C	35°C
17.2	Winding by resistance ⁰ C	40°C
18	Thickness of radiator tubes, Mm	Minimum 1.2mm
19	Details of Tank	
19.1	Material	Robust mild steel plate without pitting and low
		carbon content
19.2	Vacuum mm of Hg./ (kN/m2)	As per IS
19.3	Pressure mm of Hg.	
19.4	Is the tank lid sloped	Yes
20	Туре	Core
20.1	Core material grade	Premium grade minimum M3
20.2	Insulation of lamination	With insulation coating on both sides
20.3	Design Flux density	1.6Tesla
21	Maximum flux density at 10%over	1.9Tesla
	excitation / over fluxing, Tesla	
22	Conductor material	Copper for 100KVA
		Aluminum for 63KVA & 25KVA
22.1	Current density (HV/LV)	Maximum allowed 3.0 A per sqmm at all taps for CU winding Maximum allowed 1.5 A per sqmm at all taps for AL winding
23	Bushing / Support Insulator	
23.1	HV side Bushing /Support	12kV
	Insulator	
23.2	LV side line and neutral bushing	1.1kV
	Support Insulator	



23.3 Creepag	ge factor for all	31 mm / kV	
bushing			
	r mm/KV		
24 Rated th	nermal short time		
current			
24.1 HV bush		25 times rated current for 2 secs	
24.2 LV line a	and neutral bushing	25 times rated current for 2 secs	
25 LV	Cable	With LT cable box, (with O/G cable termination	
terminati	ion	arrangement)	
arrange	ment	For 25kVA & 63KVA Cable box shall have MCCB of	
		appropriate rating with 25kA breaking current	
		capacity	
		Insulated bus bar.	
	for cable type, size	Outgoing LT cable of size up to 4C x150sqmm	
	ation height, mm	As per cable box design	
25.3 Gland P	Plate dimension, mm	As per cable box design	
x mm			
	late material	MS / Aluminum	
	Plate thickness, mm	5mm minimum	
25.6 Phase to	o clearance inside	25 mm minimum	
box, mm	n		
25.7 Phase to	o earth inside, mm	25 mm minimum	
26 L.V ne	utral Cable termination	Additional LV Neutral shall be provided on LV Cable	
arrange		Box for direct earthing on separate pit.	
	Transformers		
27.1 Provision	n	ON all three phases on LV side	
27.2		On LV side bushing an all three phases with the	
Mounting	α	help of fibre glass mounting plate affixed to main	
		tank by nut bolt arrangement.	
27.3		Replacement should be possible by removing	
Mainten	ance requirements	fixing nut of mounting plate after removal of LT	
27.4 Accurac	v Class	cable without disturbing LT bushing. 0.5	
	y Class		
27.5 Burden		5 VA	
27.6 Type		Cast resin ring type suitable for outdoor use	
27.7 CT ratio		200/5 for 100 KVA	
		100/5 for 25 to 63 KVA	
27.8 CT term	inal Box		
27.9 Size		As per vendor standard practice	
provided		Four	
27.12 Fixing of	f terminals within the box	On horizontal slotted channel with the help of C channel available with the terminals	
	1	On tank wall	



27.14		Openable from outside with antitheft hinge, padlock		
	Box door design	facility, door fixed by stainless steel allen screw M6		
	Box door design	size, Door shall have canopy for rain protection.		
27.15		Nylon 66 material, minimum 4 sq mm, screw type for		
	Terminal strip	control wiring and potential circuit.		
27.16		PVC insulated, extruded PVC inner sheathed,		
		armoured, extruded PVC outer sheathed 1100 V		
		grade control cable as per latest edition of IS 1554		
		part 1 minimum 2.5 sq mm for signals and 4 sq		
		mm for CT with multi strand copper conductor		
	Cable and wires			
27.17		Nickel plated brass double compression		
	Cable Glands	weatherproof cable gland		
27.18		Tinned copper pre insulated Pin, Ring, Fork type as		
	Lugs on wires	applicable		
27.19	Potential signal in CT box	Tapped from main LV bushing		
27.20		Wiring diagram to be fixed on the back of door		
	Essential provision	along with CT Sec. on Aluminum engraved plate		
		fixed by rivet.		
		Nylon 66 material, minimum 4 sq mm, screw type for		
		control wiring and potential circuit. Terminal blocks to		
	Terminal Blocks to be used by the	be located in such a way to achieve the termination		
28	vendor	height as min 250mm from gland plate.20%.		
		Spare TBs to be provided		
		Sliding link type disconnecting terminal block		
28.1	Essential provision for CT terminals	screwdriver operated stud type with facility for CT		
	Essential provision for of terminals	terminal shorting material of housing		
		melamine/Nylon66		
29	Cable glands to be used by the	· · · · · · · · · · · · · · · · · · ·		
	vendor	weatherproof cable gland		
30	Painting of transformer,			
	Radiator, cable boxes etc.			
30.1	Surface preparation	By 7 tank pre-treatment process or shot/ sand		
		blasting method		
30.2	Finish on internal surfaces	Bright Yellow heat resistant and oil resistant paint		
	of the transformer	two coats. Paint shall neither react nor dissolve in		
		hot transformer insulatingoil.		
30.3	Finish on inner surface of the	White Polyurethane paint ant condensation type		
00.0	CT terminal box, HV/	two coats, minimum dry film thickness 80 microns		
	LV/LVN	two coats, minimalitally fill full childs 500 microffs		
	cable box			
20.4		Adminanty Cray ahada 622 Datumathan a mainth		
30.4	Finish on outer surface of	Adminarly Grey shade 632 Polyurethane paint two		
	the transformer, radiator,	coats, minimum dry film thickness 80 microns		
	CT terminal box,			
	HV/LV/LVN cable box			
30.5	Frame parts	Paint shade-632 as per IS 5, with 80 microns (min.),		
		Insulating oil resistant paint. Paint shall neither react		
		nor dissolve in hot transformer insulating oil.		



Ī	31	Fittings and Accessories on	
		Transformer	
	31.1	Rating and Diagram Plate	Required
Ī	31.2	Material	Anodized aluminum 16SWG

31.2	Background	SATIN SILVER	
31.3	Letters, diagram & border	Black	
32	Rating and Diagram Plate	Following details shall be provided on rating and	
	details	diagram plate as a minimum, requirement.	
		i) type/kind of transformer with winding material	
		ii) Standard to which it is manufactured	
		iii) Manufacturer's name	
		iv) Transformer serial number	
		v) Month and year of manufacture	
		vi) Rated frequency in HZ	
		vii) Rated in kV	
		viii) Number of phases	
		ix) Rated power in kVA	
		x) Type of cooling (ONAN)	
		xi) rated currents in A	
		xii) Vector group connection symbol	
		xiii) 1.2/ 50 wave impulse voltage withstand level	
		in kV	
		xiv) Power frequency withstand voltage in kV	
		xv) Impedance voltage at rated current and	
		frequency in percentage at principal, minimum	
		and maximum tap	
		xvi) Max. Total losses at 50 % rated load & at 100%	
		rated load	
		xvii) No-load loss at rated voltage and frequence	
		xviii) Continuous ambient temperature rise at	
		rated load in deg C	
		xix) Top oil and winding temperature rise at rated	
		load in deg. C	
		xx) Winding connection diagram with taps and	
		table of tapping voltage, current and power	
		xxi) Transport weight of transformer	
		xxii) Energy efficiency level.	
		xxiii) Weight of core	
		xxiv) Weight of winding	
		xxv) Weight of core and winding	
		xxvi) Total weight	
		xxvii) Volume of oi	
		xxviii) Weight of oil	



TECHNICAL SPECIFICATION FOR THREE PHASE OIL TYPE DISTRIBUTION TRANSFORMER 25KVA TO 100KVA

		xxix) Name of the Purchaser
		xxx) PO no and date
		xxxi) Guarantee period
33	Transformer oil	It should be in accordance with specification as per Annex III of this document 10% extra oil to be furnished in separate nonreturnable drum with each transformer

2 Transformer Requirements

Type of transformer	Conventional distribution transformer
Type of construction	Core type, Oil immersed
Type of cooling	Oil Natural Air Natural (ONAN)
No of phases	Three phase on primary & secondary side
No of windings	Two (one each for 3 phase primary & 3 phase secondary)
Type of service	Outdoor application
Type of mounting	Suitable for pole mounting, Double pole
	structure

The transformer shall be capable of withstanding the thermal and dynamic effects of short circuits, as specified in -"IEC 76-5: Ability to withstand short circuits" Each transformer shall be capable of withstanding for 3 seconds a bolted metallic short circuit on the terminals of either winding, with rated voltage on the other winding.

The transformers will be installed outdoor.

The transformers shall be capable of continuous operation of rated output under the operating conditions of voltage and frequency variations.

2 APPROVED MAKES OF COMPONENTS

3.1	CT	Pragati / ECS / Kappa/Narayan Powertech	
		/Nortex/Adcon/Amity Electricals/Maxwell Gilbert	
3.2	Bushings	Baroda Bushing/CJI/Jaipur/Genesis	
3.3	Tap Changer	Alwaye /Paragon	
3.4	MOG	Sukrut/Atvus	
3.5	Valves	Newman	
3.6	CRGO	Nippon/JFE/Posco/Thyssenkrupp	
3.7	Copper	Birla copper/Sterlite	
3.8	Pre compressed Pressboard	Raman Board, Mysore/ Senapathy Whiteley	
3.9	Laminated Wood	Permalli Wallance / Rochling Engineers	
3.10	Oil	Apar/Savita/Raj Petro/Gandhar/Columbia	



TECHNICAL SPECIFICATION FOR THREE PHASE OIL TYPE DISTRIBUTION TRANSFORMER 25KVA TO 100KVA

3.11	Steel	TATA/Jindal/SAIL	
3.12	Lugs/Glands	Jainson/Dowells/Comet	
3.13	Radiators	CTR/Hi-Tech Radiators /Tarang Engineers	
3.14	OTI and WTI	Precimeasure/Pecon	

Note - Any other make of component shall be approved by BSES during Detailed Design Engineering

3 SERVICE CONDITIONS

3.1 Site Conditions

S.no.	Description	Details
1	Relative humidity	
	a) Maximum	100%
	b) Minimum	10%
2	Average annual rainfall	750mm
3	Average no. of rainy days	50 per annum
4	Temperature max/min/year average	50°C / -5°C/32°C
5	Average no. of thunder storm days	40 per annum
6	Rain Months	June to October
7 Wind pressure		195 kg/m2 up to an elevation of 30 mt. As per IS:875/ 975

4 GENERAL PARTICULARS AND GUARANTEES

4.1 COMPLIANCE WITH SPECIFICATION

The transformers shall comply in all respects with the requirements of this specification. However, any minor deviations from the provisions of the specification shall be disclosed at the time of tendering.

4.2 COMPLIANCE WITH REGULATIONS

All the equipment shall comply in every respect with the Indian Regulations and acts in force.

The equipment and connections shall be designed and arranged to minimise the risk of fire and any damage which might be caused in the event of fire.

TECHNICAL SPECIFICATION FOR THREE PHASE OIL TYPE DISTRIBUTION TRANSFORMER 25KVA TO 100KVA

ANNEXUREII VENDOR DATA

(GURANTEED TECHNICAL PARTICULARS)

Note: This GTP is to be filled by the supplier in accordance with the given specification. Any deviation from the same shall be clearly highlighted and shall be supported with relevant documents.

S. No.	Description	UNIT	25kVA	63kVA	100kVA
1	Name of manufacturer				
2	Туре				
3	Ratings				
(a)	Rated output	kVA			
(b)	Rated voltage-HV	Volts			
(C)	Rated voltage-LV	Volts			
(d)	No load voltage ratio				
(e)	Number of phases				
(f)	Frequency	Hz			
4	Connections				
(a)	High voltage				
(b)	Low voltage				
(c)	Vector group symbol				
5	Method of cooling				
6	Internal dimensions of				
	tank				
(a)	Length	mm			
(b)	Breadth	mm			
(C)	Height	mm			
(d)	Thickness of tank				
	sheet				
	i)Sides	mm			
	ii)Top	mm			
	iii)Bottom	mm			
7	Details of core				
(a)	Diameter	mm			
(b)	Cross sectional area				
	i) Gross	mm ²			
	::\N -4				
	ii)Net	mm ²			
(c)	Window height	mm			
(d)	Limb center	mm			
(e)	Maximum flux density	Tesla			
` ′	at rated voltage and				



	Frequency (to be			
	supported by			
	calculations)			
(f)	Material and thickness	mm		
	of lamination			
(g)	Weight of stamping in			
	core and yoke			
	separately			
	i) Core	Kgs		
	ii)Yoke	Kgs		
	iii)Total	Kgs		
8	HV coil constructional			
	details			
(a)	Type of winding	mm		
(b)	Size of conductor	mm ²		
	(Bare)			
(C)	Cross sectional area of			
	conductor			
	i) Gross			
	ii) Net			
(d)	Number of coils per			
	limb			
(e)	Outer diameter of coil	mm		
(f)	Inner diameter of coil	mm		
(g)	Mean diameter of coil	mm		
(h)	Insulation of			
	conductor			
(i)	Interlayer			
	reinforcement detail			
(j)	Current at full load	Amp		
(k)	Normal working	Amp/ mm ²		
	current density			
(l)	End turn insulation			
(m)	Weight of bare	Kg		
	conductor used in one			
	leg of HV			
(n)	Weight of insulated	Kg		
	conductor used in one			
	leg of HV			
(o)	Number of turns per			
	leg			



(p)	Length of mean turns	mm		
(q)	I ² Rat75 ^o C (To be			
	supported by			

			I		I
	calculations)				
()	A				
(r)	Axial length	mm			
(s)	Resistance per phase	Ohms			
	at 75°C (Max)				
(t)	Weight of winding	Kg			
	with insulation in one				
	leg ofHV				
9	LV coil constructional				
	details				
(a)	Type of winding				
(b)	Size of conductor	mm			
	(Bare)				
(C)	Cross sectional area of	mm²			
	conductor				
	i) Gross				
	ii) Net				
(d)	Number of coils per				
	limb				
(e)	Outer diameter of coil	mm			
(f)	Inner diameter of coil	mm			
(g)	Mean diameter of coil	mm			
(h)	Insulation of				
	conductor				
(i)	Interlayer				
	reinforcement detail				
(j)	Current at full load	Amp			
(k)	Normal working	Amp/ mm ²			
	current				
	density				
(I)	End turn insulation				
(m)	Weight of bare	Kg			
	conductor used in one				
	leg of LV				
1			L	1	L



(n)	Weight of insulated conductor used in one leg of LV	Kg		
(o)	Number of turns per			
	leg			
(p)	Length of mean turns	mm		
(q)	I ² Rat75°C (To be			
	supported by			
	calculations)			

(r)	Axial length	mm		
(s)	Resistance per phase	Ohms		
` ′	at 75°C (Max)			
(t)	Weight of winding	Kg		
	with			
	insulation in one leg of			
	LV			
10	Insulation details			
	material and size			
(a)	HV coil end packing			
(b)	LV coil end packing			
(C)	Inter coil spacer of HT			
	sections			
(d)	Bottom core strip			
	insulation			
(e)	Yoke insulation			
(f)	Clamp insulation			
(g)	Inter phase barrier			
(h)	Core wrap			
(i)	Cylindrical insulation			
	between HT & LT			
(j)	Type of blocks used			
	between coils			
11	Details of clearances			
(a)	Internal clearance	mm		
	between inner walls of			
	tank and core coil			
	assembly unit			
	i) On length (Bushing			
	side)			
	ii) On breadth (Non			
	Bushing side)			



(b)	Radial clearance between LV and HV winding	mm		
(C)	Phase to phase clearance between HV limb	mm		
(d)	Clearance from top of the yoke to the inside of the top cover of tank	mm		
(e)	Radial clearance of LV coil from core	mm		
(f)	Horizontal duct			

between HT sectional coil (g) End clearance of HT mm coil from yoke (h) Minimum clearance between core and tank bottom 12 Impulse test voltage of winding for 1.2/50 micro seconds wave according to relevant ISS (a) HV (b) LV	
(g) End clearance of HT coil from yoke (h) Minimum clearance mm between core and tank bottom 12 Impulse test voltage of winding for 1.2/50 micro seconds wave according to relevant ISS (a) HV (b) LV	
coil from yoke (h) Minimum clearance mm between core and tank bottom 12 Impulse test voltage of winding for 1.2/50 micro seconds wave according to relevant ISS (a) HV (b) LV	
(h) Minimum clearance between core and tank bottom 12 Impulse test voltage of winding for 1.2/50 micro seconds wave according to relevant ISS (a) HV (b) LV	
between core and tank bottom 12 Impulse test voltage of winding for 1.2/50 micro seconds wave according to relevant ISS (a) HV (b) LV	
tank bottom 12 Impulse test voltage of winding for 1.2/50 micro seconds wave according to relevant ISS (a) HV (b) LV	
12 Impulse test voltage of winding for 1.2/50 micro seconds wave according to relevant ISS (a) HV (b) LV	
winding for 1.2/50 micro seconds wave according to relevant ISS (a) HV (b) LV	
micro seconds wave according to relevant ISS (a) HV (b) LV	
according to relevant ISS (a) HV (b) LV	
ISS	
(a) HV (b) LV	
(b) LV	
(-)	
40 77 16 17 17 17 17 17 17 17 17 17 17 17 17 17	
13 Volts per coil of HV Volts	
winding	
14 Approximate volts per Volts	
layer of HV winding	
15 Performance Deg. C	
reference	
temperature	
16 No load loss at rated Watts	
primary voltage and	
frequency.(Guarantee	
d value without any	
positive tolerance)	
17 Total losses	



17.1	Total losses(no load Watts		
	load losses at		
	75°C @ 50 % load)		
	(Guaranteed value		
	without any positive		
	tolerance)		
17.2	Total losses(no load		
	load losses at		
	75°C @ 100 %		
	load) (Guaranteed		
	value without any		
	positive		
	tolerance)		
18	Induced over voltage		
	test at double		
	frequency		
19	No load current at		
(a)	100% rated voltage		
	and rated frequency		
	as percentage of full		

		I	T.	
load current.				
No load current at				
112.5% of rated				
voltage as percentage				
of full load current				
Regulation at normal				
full load and UPF at				
75°C				
Regulation at normal				
full load and 0.8 Lag				
PF at75°C				
Impedance voltage at	Volts			
rated voltage and				
frequency at 75°C				
Percentage reactance				
at rated voltage and				
frequency at 75°C				
Percentage				
Resistance at 75°C				
Percentage impedance				
at 75°C				
	voltage as percentage of full load current Regulation at normal full load and UPF at 75°C Regulation at normal full load and 0.8 Lag PF at 75°C Impedance voltage at rated voltage and frequency at 75°C Percentage reactance at rated voltage and frequency at 75°C Percentage reactance at rated voltage and frequency at 75°C Percentage Resistance at 75°C Percentage Resistance impedance	No load current at 112.5% of rated voltage as percentage of full load current Regulation at normal full load and UPF at 75°C Regulation at normal full load and 0.8 Lag PF at 75°C Impedance voltage at volts rated voltage and frequency at 75°C Percentage reactance at rated voltage and frequency at 75°C Percentage Resistance at 75°C Percentage impedance	No load current at 112.5% of rated voltage as percentage of full load current Regulation at normal full load and UPF at 75°C Regulation at normal full load and 0.8 Lag PF at 75°C Impedance voltage at volts rated voltage and frequency at 75°C Percentage reactance at rated voltage and frequency at 75°C Percentage Resistance at 75°C Percentage impedance	No load current at 112.5% of rated voltage as percentage of full load current Regulation at normal full load and UPF at 75°C Regulation at normal full load and 0.8 Lag PF at 75°C Impedance voltage at rated voltage and frequency at 75°C Percentage reactance at rated voltage and frequency at 75°C Percentage Resistance at 75°C Percentage impedance



(a)	With respect to high						
	voltage						
(b)	With respect to low						
	voltage						
26	Unbalance current as						
	percentage of full load						
	current						
27	Percentage efficiency	At UPF	At 0.8	At UPF		At	At 0.8
			LagPF		LagPF	UPF	LagPF
(a)	Full load						
(b)	¾ full load						
(c)	½ full load						
(d)	1/4 full load						
28	Permissible duration						
	of overload following						
	continuous running at						
	normal rated load in						
	ambient temperature						
	of						
	50°C						
(a)	10%overload						
(b)	20%overload						
(c)	30%overload						
29	RMS value of						
	symmetrical short						

	circuit current which the transformer can withstand and its duration according to clause 9.1 of ISS-2026 or clause –1001 of BSS with latest Amendment.		
30	Increase in Temperature of winding at full load by resistance method in an ambient temperature of 50°C		
31	Increase in temperature of oil by thermometer at full load in an ambient		



	temperature of 50°C			
32	Temperature of			
02	hottest spot in the			
	winding at			
	full load in an ambient			
	temperature of 50°C			
33	Terminal arrangement			
	of HV side			
34	Terminal arrangement			
	of LV side			
35	Particulars of HV			
	bushing			
(a)	Nameofmanufacturer			
(b)	Туре			
(c)	Dry withstand voltage			
	for one minute			
(d)	Wet withstand voltage			
	for thirty minutes			
(e)	Voltage rating			
(f)	Impulse withstand			
	voltage 1.2/50 micro			
	second wave			
	i)Positive			
, ,	ii)Negative			
(g)	Total creepage	mm		
	distance in air			
(h)	Height of bushing			
	above transformer			

	tank		
36	Particulars of LV		
	neutral bushing		
(a)	Nameofmanufacturer		
(b)	Туре		
(c)	Voltage rating		
(d)	Dry withstand voltage		
	for one minute		



	(e)	Wet withstand voltage			
		for thirty minutes			
	(f)	Total creepage	mm		
		distance in air			
	(g)	Height of bushing	mm		
		above transformer			
		tank			
	37	Time constant of			
		transformer			
	38	Transformer oil			
	(a)	Dielectric strength			
	(b)	Resistivity			
	(c)	Acidity			
	(d)	Tan delta			
	(e)	Name of supplier			
	39	Quantity of	Litres		
		transformer			
Į		oil			
	40	Weight of the			
		following			
	(a)	Tank and fittings	Kgs		
	(b)	Core and windings	Kgs		
	(c)	Transformer oil	Kgs		
	(d)	Total weight of	Kgs		
		transformer including			
		oil			
	41	Overall dimensions of			
		transformer			
Ī	(a)	Length	mm		
	(b)	Breadth	mm		
Ī	(c)	Height	mm		
Í	42	Name of material and			
		size used for clamping			
		of core winding			
Í	(a)	Core clamp			
Ī	(b)	Tie rod			
Ī	(c)	Core bolt			

(d)	Bottom plate		
43	Size of conservator		
(a)	Volume		
(b)	Length/ diameter		
(c)	Sheet thickness		



detta and line leads 45 Core earthing material 46 Silica gel breather i)Make ii)Size 47 Clearance between phases and phases to earth in air (a) Phase to phase (LV side) (b) Phase to phase (LV mm side) (c) HV to earth mm (d) LV to earth mm (d) LV to earth mm (a) Is the offered 11kV/415V, conventional distribution transformer type tested? (Yes, No) (b) If yes, when and where was it type tested? (c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Name of test Date of test Wheth If yes, Wheth If yes, rer test No. of report sheets enclos encl	44	Size of material of							
45 Core earthing material 46 Silica gel breather i)Make ii)Size 47 Clearance between phases and phases to earth in air (a) Phase to phase (HV side) (b) Phase to phase (LV mm side) (c) HV to earth mm (d) LV to earth mm (d) LV to earth mm (d) LV to earth mm (a) Istheoffered 11kV/415V, conventional distribution transformer type tested? (Yes, No) (b) If yes, when and where was it type tested? (c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Name of test Date of test Wheth er test no.0 of report enclose enc	' '								
46 Silica gel breather i)Make ii)Size 47 Clearance between phases and phases to earth in air (a) Phase to phase (LV side) (b) Phase to phase (LV side) (c) HV to earth mm (d) LV to earth mm 48 Type testing (a) Is the offered 11kV/415V, conventional distribution transformer type tested? (Yes, No) (b) If yes, when and where was it type tested? (c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Name of test Date of test Wheth If yes, Whethe If yes, Whethe er test No. of report sheets report sheets report sheets report sheets report sheets report sheets report enclose en	45								
i)Make ii)Size 47 Clearance between phases and phases to earth in air (a) Phase to phase(HV side) (b) Phase to phase (LV side) (c) HV to earth mm (d) LV to earth mm 48 Type testing (a) Is the offered 11kV/415V, conventional distribution transformer type tested? (Yes,No) (b) If yes, when and where was it type tested? (c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Name of test Date of test Wheth er test No. of report sheets re		_							
ii)Size 47 Clearance between phases and phases to earth in air (a) Phase to phase (HV side) (b) Phase to phase (LV side) (c) HV to earth mm (d) LV to earth mm 48 Type testing (a) Is the offered 11kV/415V, conventional distribution transformer type tested? (Yes, No) (b) If yes, when and where was it type tested? (c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Name of test Date of test Wheth er test No. of report sheets repo									
47 Clearance between phases and phases to earth in air (a) Phase to phase(HV side) (b) Phase to phase (LV side) (c) HV to earth mm (d) LV to earth mm 48 Type testing (a) Is the offered 11kV/415V, conventional distribution transformer type tested? (Yes, No) (b) If yes, when and where was it type tested? (c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Name of test Date of test Wheth er test ereport sheets enclose ed or not(Y/N) Date of earth mm ### Wheth If yes, Wheth report sheets enclose enclos ed or not(Y/N) ### Wheth If yes, Wheth report sheets enclose ed or not(Y/N) ### Wheth If yes, when If yes, of the ereport sheets enclose enclos enclose ed or not(Y/N) ### Wheth If yes, or test sheets enclose enclose ed or not(Y/N) ### Wheth If yes, or test sheets enclose enclose ed or not(Y/N) ### Wheth If yes, or test sheets enclose enclose ed or not(Y/N) ### Wheth If yes, or test sheets enclose enclose ed or not(Y/N) ### Wheth If yes, or test sheets enclose enclose ed or not(Y/N) ### Wheth If yes, or test sheets enclose enclose ed or not(Y/N) ### Wheth If yes, or test sheets enclose enclose ed or not(Y/N) ### Wheth If yes, or test sheets enclose enclose ed or not(Y/N) ### Wheth If yes, or test sheets enclose enclose enclose enclose ed or not(Y/N) ### Wheth If Yes, If Yes, or test sheets enclose e									
phases and phases to earth in air (a) Phase to phase (HV side) (b) Phase to phase (LV mm side) (c) HV to earth mm (d) LV to earth mm 48 Type testing (a) Isthe offered 11kV/415V, conventional distribution transformer type tested? (Yes, No) (b) If yes, when and where was it type tested? (c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Name of test Date of test Wheth er test sheets report sheets report sheets enclose ed or not(Y/N) Date of test wheth endos endos endos ed d or not(Y/N) Date of test wheth endos endos endos ed ed or not(Y/N)	47								
earth in air (a) Phase to phase(HV side) (b) Phase to phase (LV side) (c) HV to earth mm (d) LV to earth mm 48 Type testing (a) Is the offered 11kV/415V, conventional distribution transformer type tested? (Yes, No) (b) If yes, when and where was it type tested? (c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Name of test Date of test Wheth er test sheets report sheets report sheets enclose ed or not(Y/) No. of retest No. of er test sheets enclose enclose ed ed or not(Y/)									
Side C Phase to phase (LV side) Phase to		1 '							
Side C Phase to phase (LV side) Phase to phase the phase to phase the phase to phase the phas	(a)	Phase to phase(HV	mm						
(b) Phase to phase (LV side) (c) HV to earth mm (d) LV to earth mm 48 Type testing (a) Is the offered 11kV/415V, conventional distribution transformer type tested? (Yes, No) (b) If yes, when and where was it type tested? (c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Name of test Date of test Wheth If yes, Wheth If yes, report sheets report sheets enclos enclos ed or ed not(Y/) not(Y/N) report sheets enclos en		, , ,							
Side CC	(b)	,	mm						
CC									
Column C	(c)		mm						
Type testing Is the offered 11kV/415V, conventional distribution transformer type tested? (Yes, No) If yes, when and where was it type tested?		LV to earth	mm						
11kV/415V, conventional distribution transformer type tested? (Yes, No) (b) If yes, when and where was it type tested? (c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Name of test Date of test Wheth er test No. of report sheets report sheets report sheets enclos ed or ed or not(Y/N) If yes, Wheth If yes, Wheth Report sheets report sheets report sheets report sheets enclos		Type testing							
conventional distribution transformer type tested? (Yes, No) (b) If yes, when and where was it type tested? (c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Name of test Date of test Wheth ere test no. of report sheets enclos	(a)	Is the offered							
distribution transformer type tested?(Yes,No) (b) If yes, when and where was it type tested? (c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Date of test Wheth er test No. of report sheets enclos ed or not(Y/) wheth lf yes, r test No. of report sheets enclos enclo		11kV/415V,							
transformer type tested?(Yes, No) (b) If yes, when and where was it type tested? (c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Date of test Wheth If yes, er test No. of report sheets enclos ed or ed not(Y/N) Whethe If yes, No. of report sheets enclos enclos enclos enclos enclos enclos enclos ed or not(Y/N)		conventional							
type tested? (Yes, No) (b) If yes, when and where was it type tested? (c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Name of test Date of test Wheth If yes, Whethe If yes, Wheth If yes, er test No. of report sheets report sheets report sheets enclos		distribution							
(b) If yes, when and where was it type tested? (c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Name of test Date of test Wheth er test report sheets enclos encl									
where was it type tested? (c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Name of test Date of test Wheth If yes, wheth If yes, wheth If yes, or test No. of report sheets report sheets report sheets enclos enclos enclos ed or not(Y/) wheth If yes, wheth If yes, report sheets report sheets report sheets enclos enclos enclos enclos enclos ed or not(Y/N)									
tested? (c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Date of test Wheth If yes, er test No. of report sheets report sheets enclos ed or not(Y/) enclos ed or not(Y/) Conventional type distribution transformer? If yes, give details. Date of test Wheth If yes, report sheets report sheets enclos enclos enclos enclos enclos enclos ed or not(Y/)	(b)								
(c) Is there any deviation in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Name of test Date of test Wheth If yes, er test No. of report sheets Point Poi									
in the technical specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Date of test Wheth er test No. of report sheets report sheets report sheets enclos ed or not(Y/ not(Y/N)) Whether If yes, Whether If yes, report sheets report sheets report sheets enclos enclos ed or not(Y/N)									
specification of offered 11kV/415V conventional type distribution transformer? If yes, give details. Name of test Date of test Wheth If yes, whethe If yes, whethe er test No. of report sheets report sheets report sheets enclos enc	(c)	· -							
offered 11kV/415V conventional type distribution transformer? If yes, give details. Date of test Wheth If yes, er test No. of r test No. of report sheets report sheets enclos enclose enclos									
11kV/415V conventional type distribution transformer? If yes, give details. Date of test Wheth If yes, er test No. of r test No. of report sheets report sheets report sheets enclos enclose enclos enclose enclos enclose enclos enclos enclose enclos enclose enclos enclose enclos		1 -							
conventional type distribution transformer? If yes, give details. Name of test Date of test Wheth er test No. of r test No. of report sheets report sheets enclos enclose e									
distribution transformer? If yes, give details. Name of test Date of test Wheth If yes, Whethe er test No. of r test No. of report sheets report sheets report sheets enclos enclose enclos									
transformer? If yes, give details. Date of test Wheth If yes, Whethe If yes, wheth er test No. of report sheets report sheets enclos enclose									
give details. Date of test Wheth If yes, Whethe If yes, Wheth If yes,									
Name of test Date of test Wheth If yes, whethe If yes, received the properties of test and the prope		1							
er test No. of r test No. of er test No. of report sheets report sheets enclos enclos enclos ed or ed d or not(Y/) report sheets report sheets report sheets enclos		-	Date of test	Wheth I	f vos	Whethe	If ves	Whath	If ves
report sheets report sheets report sheets enclos enclos enclos ed or ed d or not(Y/N) sheets report sheets enclos		INAILIE OI 1681	שמוב טו ופצו		-		-		-
enclos enclos enclose enclos e									
ed or ed d or ed ed or ed not(Y/)						-		-	
						(' /		N)	



TECHNICAL SPECIFICATION FOR THREE PHASE OIL TYPE DISTRIBUTION TRANSFORMER 25KVA TO 100KVA

i)	Unbalance current				
''	Test				
::)					
ii)	Impulse voltage				
	withstand test				
iii)	Temperature rise test				
iv)	Short circuit test				
v)	Thermal ability test				
vi)	Air pressure test				
49	Whetheryouwilluse				
	specified aluminium				
	alloy or brass copper				
	with suitable				
	bimetallic				
	arrangement for				
	HV/LV				
	Connector				
50	Have you submitted				
	drawing and				
	calculation of cross				
	sectional areaof				
	core?(Yes/No)				
51	Have you submitted				
	calculation for				
	computation of no				
	load and load loss at				
	750Cas per design				
	data of offered				
	transformers?				
	(Yes/No)				
52	Any other information				

ANNEXURE III TRANSFORMER OIL

The insulating oil shall have following features:

S.No.	Item description	Specification requirement		
1.1	Appearance of oil	Clear, free from sediment and		
1.1		suspended matter		
1.2	Viscosity Max.	15 mm2 /s at 40°C		
1.2		1800 mm2 /s at 0°C		
1.3	Pour Point, Max	-10°C		



TECHNICAL SPECIFICATION FOR THREE PHASE OIL TYPE DISTRIBUTION TRANSFORMER 25KVA TO 100KVA

1.4	Water content, Max	30 mg/Kg
1.5	Breakdown voltage	
i)	New unfiltered oil. Min.	30 kV
ii)	After filtration Min.	70 kV
1.6	Density Max.	0.895 g/ml at 20°C
1.7	Dielectric dissipation factor Max	0.005 at 90 °C,
1.8	Particle Content	Value to be provided by the vendor
1.9	Acidity Max	0.01 mg KOH/g
1.10	Interfacial tension at 27°C Min	40 mN/m
1.11	Total sulphur content	Value to be provided by the vendor
1.12	Corrosive sulfur	Not-corrosive
1.13	Potentially Corrosive sulfur	Not-corrosive
1.14	DBDS	Not detectable (<5 mg/kg)
1.15	Inhibitor	Not detectable (<0.01%)
1.16	Metal Passivator	Not detectable (<5 mg/kg)
1.17	Other additives	Type and concentration of additives to be provided by the vendor
1.18	2-furfural and related Compounds content	Not detectable (<0.05 mg/kg) for each individual compound
1.19	Oxidation stability	
a)	Total acidity, Max	1.2 mg KOH/g
b)	Sludge Max	0.8%
c)	DDF at 90 °C, Max	0.5
1.20	Gassing Tendency	Value to be provided by the vendor

c)	DDF at 90 °C, Max	0.5
1.20	Gassing Tendency	Value to be provided by the vendor
1.21	ECT	Value to be provided by the vendor
1.22	Flash point Min.	135°C,
1.23	PCA content Max	3%
1.24	PCB content	Not detectable (<2 mg/Kg)

ANNEXURE-IV: CRGO & TESTING REQUIREMENT

1	lition to the BSES specification following points to be verified during manufacturing/inspection for 100kVA DT only)
1	Transformer core shall be low loss, non-ageing, high permeability PRIME GRADE CRGO with M3 Grade or better with max thickness of 0.23mm and with max core loss of 1W/Kg, perfectly insulated and clamped to minimize noise and vibrations.
2	Following stage inspections will be carried out by purchaser or by third party engineers appointed by BSES:
2.1	Reconciliation of mother coil by checking stamp & seal at factory before slitting. One sample of CRGO to be sealed for testing at CPRI/ERDA.
2.3	Following documents to be submitted during the stage inspection :
2.3.1	Invoice of supplier
2.3.2	Mills test certificates



TECHNICAL SPECIFICATION FOR THREE PHASE OIL TYPE DISTRIBUTION TRANSFORMER 25KVA TO 100KVA

2.3.3	Packing list
2.3.4	Bill of lading
2.3.5	Bill of entry certificates by customs
2.4	BSES may appoint recognized testing authority like CPRI /ERDA with their instruments & engineer's team and measure no load loss, load loss and percentage impedance of the transformer at supplier's works at our own cost. Bidder shall agree and give them full cooperation during their stay & testing at shop floor. The losses & impedance values so obtained will be considered as final.
2.5	Bidder should have in-house NABL accredited testing facility. In case of unavailability of in house NABL accredited lab testing of bidder, one Transformer of each rating shall be randomly selected and sealed by BRPL representative for complete acceptance test as per IS -1180(including temperature test) at third party NABL Lab. Tests shall be conducted once per Rate contract at bidder's cost.

ANNEXURE-V: STANDARD BSES QAP (to be followed for testing/ inspection)